

#### Overview



MAG 8000 is a comprehensive meter which intelligent information and high performance measurement as well as the easy to install concept take cost of ownership and customer service to a new level for water meter.

#### Benefits

##### **Easy to install**

- Compact or remote solution with factory mounted cable and customer setting from factory
- IP68/NEMA 6P enclosure. Sensor can be buried
- Flexible power supply - internal or external battery pack or mains power supply with battery back-up possibilities
- Superior measurement
- Down to 0.2 % maximum uncertainty
- OIML R 49 type approval
- PTB K7.2
- FM Fire Service Approval
- Bi-directional measurement

##### **Long lasting performance/Low cost of Ownership**

- Verification according to Directive 2014/32/EU of the European Parliament and Council of 26 February, 2014 on measuring instruments, Annex VI Thermal Energy Meters (MI-004)
- No moving parts means less wear and tear
- Up to 6 to 10 years maintenance-free operation in typical revenue application
- Robust construction built for the application

##### **Intelligent information, easy to access**

- Advanced information on site
- Data logger
- Advanced statistics and diagnostics
- Add-on communication modules

#### Application



The following MAG 8000 versions are available as stand-alone water meters:

- MAG 8000 (7ME6810) for abstraction and distribution network
- MAG 8000 CT (7ME6820) for revenue and bulk metering
- MAG 8000 (7ME6880) for irrigation

#### Design

MAG 8000 is designed to minimize power consumption. The product program consists of

- Basic and advanced version
- Sensor sizes from DN 25 to 1200 (1" to 48")
- Compact and remote installation in IP68/NEMA 6P enclosure and factory-mounted cable
- SIMATIC PDM and Flow Tool PC configuration softwares

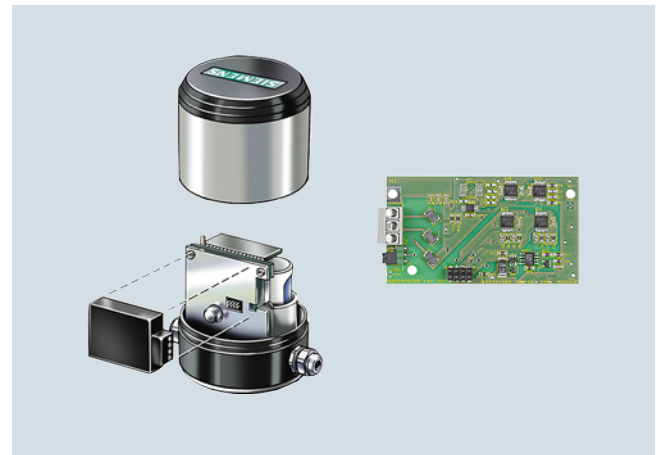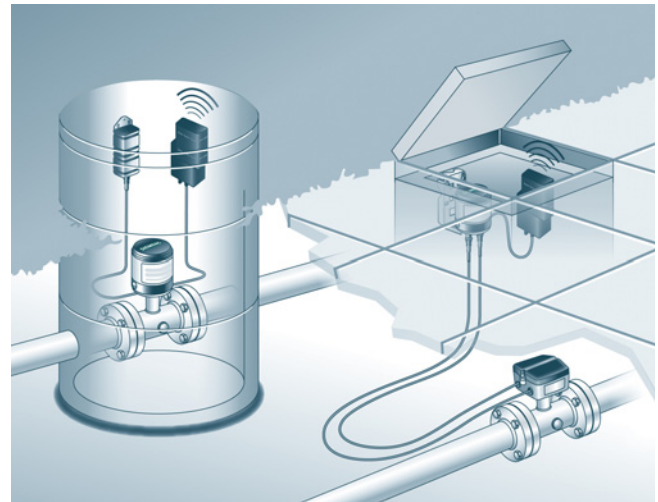


Modbus/Encoder module

## Flow Measurement

### SITRANS F M

#### Battery-operated water meter MAG 8000

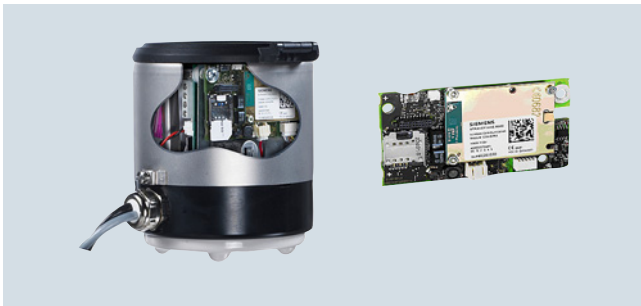

GSM/GPRS communication module



PC-IrDA connection

#### **MAG 8000 GSM/GPRS Wireless Communication Module**

The MAG 8000 GSM/GPRS wireless communication module provides the latest mobile technology using a Quad Band (850/900/1800/1900 MHz) module.

The GSM/GPRS module logs data from the MAG 8000 memory and from the two analog inputs (one 4 to 20 mA not powered by the module and one 5 V ratiometric powered by the module) and storage in the internal memory and later transmit it into a system or PC via email or SMS.

An additional synchronization function secures the initial collection time of the data independent of the sample rate used (minimum collection time: 1 per minute).

The package of information retrieved via the csv file includes:

- Time stamp
- Flow rate
- Tot 1
- Tot 2
- Tot 3
- Analog 1 (mA)
- Analog 2 (V)
- Battery lifetime
- Alarm list (as decimal format)

The GPRS technology makes it possible to send a higher amount of data via email. The data is secured using a POP 3 server configuration avoiding encryptions that require additional software. The configuration of the module is performed via SMS commands that allow you to define the users, email accounts, transmission settings, collection, etc.

The GSM/GPRS module is a compact built-in solution which can be installed in the existing MAG 8000 with SW version 3.02 and higher.

The battery lifetime will depend on signal strength and especially on the number of transmissions. Therefore we recommend an optimal setting of transmission once a day (see page 3/120). The module also includes the same power management algorithm that secures a very good calculation of the remaining battery lifetime.

The OPC server specifically designed for the MAG 8000 GSM/GPRS module is offered free of charge. With this value-added package, the opportunity for measurement data collection and further processing/analyzing for system integration and automation is offered.

#### Function

MAG 8000 is a microprocessor-based water meter with graphical display and key for optimum customer operation and information on site. The transmitter drives the magnetic field in the sensor, evaluates the flow signal from the sensor and calculates the volume passing through. It delivers the required information via the integrated pulse output or communication interfaces as part of a system solution. Its intelligent functionality, information and diagnostics ensure optimum meter performance and information to optimize water supply and billing.



MAG 8000 can be ordered as a Basic or an Advanced version.

Features / Version	MAG 8000 Basic/ MAG 8000 Irrigation	MAG 8000 Advanced
Measuring frequency in battery power mode (Manually selected) <sup>1)</sup>	1/15, 1/30 or 1/60 Hz	from 6.25 to 1/60 Hz depending of sensor size
Output MAG 8000	2 FW/RV/AI/CA (max. 50 Hz pulse rate)	2 FW/RV/AI/CA (max. 100 Hz pulse rate)
Communication	Add-on	Add-on
Data logger	Yes	Yes
Insulation test	No	Yes
Leakage detection	No	Yes
Meter utilization	No	Yes
Statistics	No	Yes
Tariff	No	Yes
Settle date (Revenue)	No	Yes

<sup>1)</sup> Excitation frequency settings with mains power supply, see technical specifications for each version

Some information is accessible via the display whereas all information is accessible via the IrDA communication interface with the PDM software. Data and parameters are registered in a EEPROM. They can all be read, but changing the information demands a software password or a hardware key attached to the printed circuit board.

The SIMATIC PDM tool gives the possibility of testing and verifying the flowmeter on site and creating a printed "Qualification Certificate" with all specific data that define the quality status of the measurement.

The Qualification Certificate consists of two pages with information about the actual status of the sensor:

Part 1 provides general settings, sensor and battery info, totalizer values and pulse output settings.

Part 2 provides detailed information about electronic and sensor functionality and a main parameter list for evaluating the functionality of the MAG 8000 water meter.



#### SIMATIC PDM

Details about the SIMATIC PDM tool can be found in chapter "Communication and Software" (see page 8/5).

## Flow Measurement

### SITRANS F M

#### Battery-operated water meter MAG 8000

#### Technical specifications

Transmitter	
<b>Installation</b>	Compact (integral) Remote with factory-mounted cable 5, 10, 20 or 30 m (16.4, 32.8, 65.6 or 98.4 ft)
<b>Enclosure</b>	Stainl. steel top housing (AISI 316) and coated brass bottom. Remote wall mount bracket in stainless steel (AISI 304).
<b>Cable entries</b>	2 x M20 (one gland for one cable of size 6 ... 8 mm (0.02 ... 0.026 ft) is included in the standard delivery)
<b>Display</b>	Display with 8 digits for main information. Index, menu and status symbols for dedicated information
Resolution	Totalized information can be displayed with 1, 2 or 3 decimals or automatic adjustment (default)
<b>Flow unit</b>	
Europe	Volume in m <sup>3</sup> and flow rate in m <sup>3</sup> /h
US	Volume in Gallon and flow rate in GPM
Australia	Volume in MI and flow rate as MI/d
<b>Optional display units</b>	Volume: m <sup>3</sup> x 100, l x 100, G x 100, G x 1000, MG, CF x 100, CF x 1000, AF, Al, kl, BBL42 Flow: m <sup>3</sup> /min, m <sup>3</sup> /d, l/s, l/min, GPS, GPH, GPD, MGD, CFS, CFM, CFH, BBL42/s, BBL42/min, BBL42/h, BBL42/d
<b>Digital output</b>	2 passive outputs (MOS), individual galvanically isolated Maximum load ± 35 V DC, 50 mA short circuit protected
Output A function	Programmable as pulse volume – forward – reverse – forward/net – reverse/net
Output B function	Programmable as pulse volume (like output A), alarm
Output	Max. pulse rate of 50 Hz (only Basic version) and 100 Hz (only Advanced version), pulse width of 5, 10, 50, 100, 500 ms
<b>Communication</b>	IrDA: Standard integrated infrared communication interface with Modbus RTU protocol
Add-on modules	<ul style="list-style-type: none"> <li>• RS 232 serial interface with Modbus RTU (Rx/Tx/GND), point to point with max. 15 m cable</li> <li>• RS 485 serial interface with Modbus RTU (+/-/GND), multidrop with up to 32 devices with max. 1000 m cable</li> <li>• Encoder interface module (for Itron 200WP) "Sensus protocol"</li> <li>• GSM/GPRS module with or without analog input cable</li> </ul>
<b>Power supply</b>	Auto detection of power source with display symbol for operation power.
Internal battery pack	1 D-Cell 3.6 V/16.5 Ah
External battery pack	2 D-Cell 3.6 V/33 Ah 4 D-Cell 3.6 V/66 Ah

#### Mains power supply

- 12 ... 24 V AC/DC (10 ... 32 V) 2 VA
  - 115 ... 230 V AC (85 ... 264 V) 2 VA
- Both mains power supply systems are upgradable for battery backup via internal D-Cell (3.6 V 16.5 Ah) or external battery pack.  
3 m (9.8 ft) for external connection to mains supply (without cable plug)

Cable

### Battery-operated water meter MAG 8000

Features	
<b>Application identification</b>	Tag number up to 15 characters
<b>Time and date</b>	Device embedded Real Time Clock (Synchronization with NTP server if GSM/GPRS module connected)
<b>Totalizer</b>	
MAG 8000	3 totalizer: Configurable to Forward, Reverse and Bidirectional netflow 1 totalizer (following totalizer 1 setting) resetable via display key
<b>Measurement</b>	
Low flow cut-off	
• 7ME6810	Cut-off at 15 mm/s
• 7ME6820	Cut-off at 15 mm/s
• 7ME6880	1 % of Qmax (adjustable)
Empty pipe detection	Symbolised in display
Data logger	Logging of 26 records: selectable as daily, weekly or monthly logging
<b>Alarm</b>	Active alarm is indicated on the display
<b>Data protection</b>	All data stored in an EEPROM. Totalizers 1 and 2 are backed up every 10 min, statistic every hour and power consumption and temperature measurement every 4 hour. Password protection of all parameters and hardware protection of calibration and revenue parameters.
<b>Battery power management</b>	Optimal battery information on remaining capacity. Calculated capacity includes all consuming elements and available battery capacity is adjusted related to change in ambient temperature. Numbers of power-ups Date and time registered for first and last time power alarm.
<b>Diagnostic</b>	
Continuous self test including	Coil current to drive the magnetic field Signal input circuit Data calculation, handling and storing
Alarm statistics and logging for fault analyzing	Electrode impedance to check actual media contact Flow simulation to check pulse and communication signal chain for correct scaling Number of sensor measurements (excitations) Transmitter temperature (battery capacity calculation) Low impedance alarm for change in media Flow alarm when defined high flow exceeds Verification mode for fast measure performance check
<b>Insulation test</b> (only Advanced version)	Test of signal immunity against disturbance and bad installation. Test interval is selectable and measurement is interrupted during the test period of 4 min.
<b>Leakage detection</b> (only Advanced version)	Monitoring the lowest flow or volume during selected time window within 24 hours. Leakage is detected over a selectable period where monitored value exceed the possible leakage level. Min and max values are stored with date registration. Last store value visible on the display.
<b>Meter Utilization</b> (only Advanced version)	6 registers for monitoring total time the meter has operated in different flow intervals. Registered intervals are free selectable as % of $Q_n$ (Q3)
<b>Tariff</b> (only Advanced version)	6 tariff registers count the volume delivered within the selected tariff windows, based on time of day or flow rates or a combination. Tariff can also be used for consumption profile where consumption is related to different time intervals or flow rates. Tariff values visible on the display.
<b>Settling date</b> (only Advanced version)	On a predefined date the totalizer 1 index value is stored. Old values are stored to show the latest two totalized 1 index values. Settling values visible on the display.
<b>Statistic</b> (only Advanced version)	Min. flow rate with time and date registration Max. flow rate with time and date registration Min. daily consumption with date registration Max. daily consumption with date registration Latest 7 days total and daily consumption Actual month consumption Latest month consumption
<b>PC Configuration Software PDM</b>	<ul style="list-style-type: none"> <li>• Meter configuration – online and offline mode</li> <li>• Own parameter settings</li> <li>• Parameter documentation</li> <li>• Print and export of data and parameters</li> <li>• PDM 8.2 Service Pack 1</li> </ul>

# Flow Measurement

## SITRANS F M

### Battery-operated water meter MAG 8000


#### MAG 8000 water meter uncertainty

To ensure continuous accurate measurement, flowmeters must be calibrated. The calibration is conducted at Siemens flow facilities with traceable instruments referring directly to the physical unit of measurement according to the International System of Units (SI).

Therefore, the calibration certificate ensures recognition of the test results worldwide, including the US (NIST traceability).


Siemens offers accredited calibrations assured to ISO 17025 in the flow range from 0.0001 m<sup>3</sup>/h to 10 000 m<sup>3</sup>/h. Siemens Flow Instruments accredited laboratories are recognized by ILAC MRA (International Laboratory Accreditation Corporation - Mutual Recognition Arrangement) ensuring international traceability and recognition of the test results worldwide.

The selected calibration determines the accuracy of the meter. A standard calibration results in max. ± 0.4 % uncertainty and an extended calibration ± 0.2 % (for MAG 8000 irrigation ± 0.8 %). A calibration certificate follows every sensor and calibration data are stored in the meter unit.

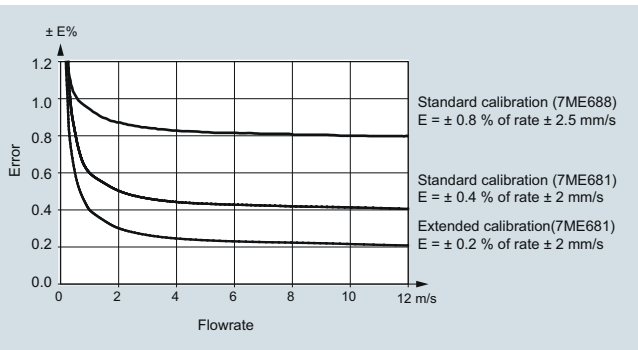


#### MAG 8000 (7ME6810) for Fire Service applications

MAG 8000 (7ME6810) is FM Fire Service approved for automatic fire protection systems according to the Fire Service Meters Standard, Class Number 1044. The approval is applicable for the sizes DN 50, DN 80, DN 100, DN 150, DN 200, DN 250, and DN 300 (2", 3", 4", 6", 8", 10", and 12") with ANSI B16.5 Class 150 flanges. The FM Fire Service approved product can be ordered via the Z-options P20, P21 and P22

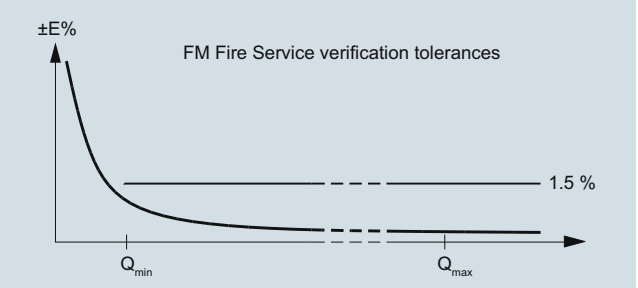


#### Grounding

The sensor body must be grounded using grounding straps and/or grounding rings to protect the flow signal against stray electrical noise. This ensures that the noise is carried through the sensor body and a noise-free measuring area within the sensor body. For MAG 8000 Irrigation grounding rings on both sides are factory-mounted.

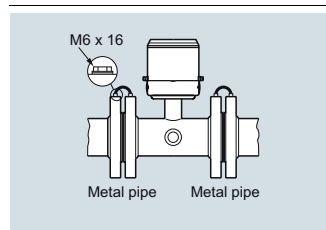

#### Metal pipes


On metal pipes, connect the straps to both flanges.

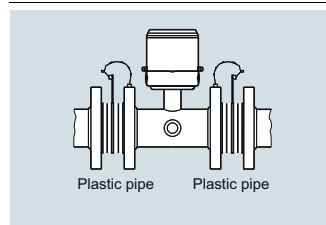

#### Plastic pipes

On plastic pipes and lined metal pipes, optional grounding rings must be used at both ends.

Grounding rings has to be ordered separately see „Grounding ring kit“

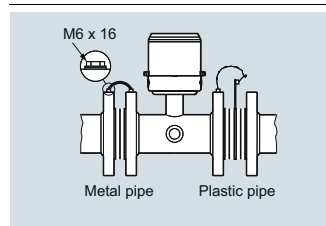


#### Combination of metal and plastic pipes

A combination of metal and plastic requires straps for metal pipe and grounding rings for plastic pipe.

#### Battery operation time and calculation

The battery operation time depends on the connected battery pack as well as the operation condition of the meter.

MAG 8000 calculates the remaining capacity every 4 hours and includes all consuming elements. Calculation compensates for temperature influence on battery capacity.

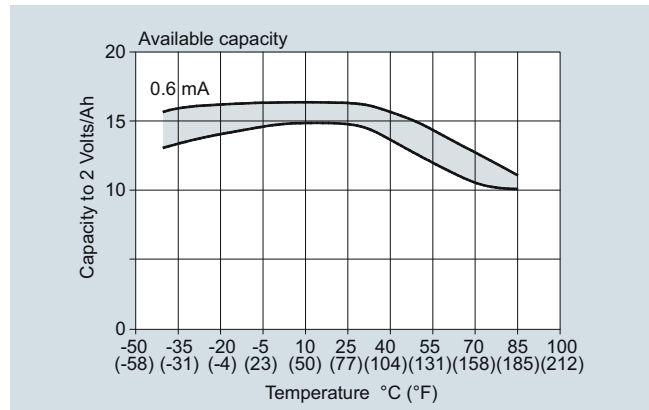

The graphic shows the effect from other temperatures. A variation in temperature from 15 °C to 55 °C (59 to 131 °F) reduces the capacity by 17% from 15 Ah to 12.5 Ah.

At typical revenue scenario of expected battery operation time can be seen in the table below.

The measurement for calculating the rest capacity of the battery life time is only completed if the system has no active fatal faults or the empty pipe is active. Maximum battery specification is 10 years operation.

3



**Scenario - Revenue application**

Output A	Pulse rate max. 10 Hz
Output B	Alarm or call-up
Meter dialog	1 hour per month
Add-com	None
Temperature	<ul style="list-style-type: none"> <li>• 5 % at 0 °C (32 °F)</li> <li>• 80 % at 15 °C (59 °F)</li> <li>• 15 % at 50 °C (122 °F)</li> </ul>

**Battery lifetime (subject to the assumptions mentioned above)****MAG 8000 for abstraction and distribution network applications (7ME6810) and MAG 8000 CT for revenue and bulk metering (7ME6820)**

Excitation frequency (24 h operation)		1/60 Hz	1/30 Hz	1/15 Hz	1/5 Hz	1.5625 Hz	3.125 Hz	6.25 Hz
2 D-Cell battery 33 Ah Internal battery pack	DN 25 ... 200 (1" ... 8")	9 years	9 years	7 years	43 months	8 months	3 months	2 months
	DN 250 ... 600 (10" ... 24")	9 years	6 years	4 years	22 months	3 months	1 month	N/A
	DN 700 ... 1 200 (28" ... 48")	7 years	4 years	2 years	12 months	1 month	N/A	N/A
4 D-Cell battery 66 Ah External battery pack	DN 25 ... 200 (1" ... 8")	15 years	15 years	14 years	86 months	16 months	7 months	4 months
	DN 250 ... 600 (10" ... 24")	15 years	13 years	8 years	44 months	7 months	3 months	N/A
	DN 700 ... 1 200 (28" ... 48")	14 years	9 years	5 years	24 months	3 months	N/A	N/A

**MAG 8000 for irrigation applications (7ME6880)**

Excitation frequency (24 h operation)		1/60 Hz	1/30 Hz	1/15 Hz	1/5 Hz	1.5625 Hz	3.125 Hz
1 D-Cell battery Internal battery pack	DN 25 ... 600 (1" ... 24")	52 months	3 years	25 months	12 months	2 months	1 month
	DN 700 ... 1 200 (28" ... 48")	3 years	2 years	1 years	6 months	1 month	N/A
2 D-Cell battery 33 Ah Internal battery pack	DN 50 ... 600 (2" ... 24")	8 years	6 years	4 years	22 months	3 months	2 months
	DN 700 ... 1 200 (28" ... 48")	6 years	4 years	2 years	12 months	1 month	N/A
4 D-Cell battery 66 Ah External battery pack	DN 50 ... 600 (2" ... 24")	10 years	10 years	8 years	44 months	7 months	4 months
	DN 700 ... 1 200 (28" ... 48")	10 years	8 years	5 years	24 months	3 months	N/A

**MAG 8000 GSM/GPRS battery lifetime scenario**

Transmission once a day and MAG 8000 factory settings

2 D-Cell battery 33 Ah Internal battery pack	3 years
4 D-Cell battery 66 Ah External battery pack	7 years

External battery pack can be used as battery backup for mains power supply (if two cable entries in one cable gland are needed, order cable glands with two entries, see accessories on page 3/138).

Serial RS 232/RS 485 add-on communication modules are designed for mains powered systems as the battery operation time will be reduced. At 1 hour communication per month (all meter data collected 2 times per day) and the module is connected, the operation time is reduced to:

- RS 232:
  - low excitation frequency: 10 % of calculated operation time
  - high excitation frequency: 80 % of calculated operation time
- RS 485:
  - low excitation frequency: 50 % of calculated operation time
  - high excitation frequency: 90 % of calculated operation time

## Flow Measurement

### SITRANS F M

#### MAG 8000 for abstraction and distribution network applications (7ME6810)

#### Overview



#### Benefits

##### Easy to install

- Compact or remote solution with factory mounted cable
- IP68/NEMA 6P enclosure. Sensor can be buried.
- Flexible power supply - internal or external battery pack or mains power supply with battery back-up possibilities

##### Long-term stability/Low cost of ownership

- No moving parts in a robust construction means less wear and tear
- Basic and advanced transmitter versions with different optional add-on communication modules fulfil various customer requirements for high cost efficiency
- Up to 0.2 % maximum uncertainty
- Bi-directional measurement with an outstanding low flow performance
- Up to 10 years maintenance-free operation in typical applications

##### Intelligent information, easy to access

- Advanced information on site
- Advanced statistics and diagnostics
- Optional high-performance GSM/GPRS module offers an efficient solution for remote measurement and monitor via wireless communication.

#### Technical specifications

Meter	
<b>Accuracy</b>	Standard calibration: ± 0.4 % of rate ± 2 mm/s Extended calibration DN 50 ... DN 300 (2" ... 12"): ± 0.2 % of rate ± 2 mm/s
<b>Low flow cut-off (default)</b>	0.05 %
<b>Media conductivity</b>	Clean water > 20 µs/cm
<b>Temperature</b>	
Ambient	-20 ... +60 °C (-4 ... +140 °F)
Media	0 ... 70 °C (32 ... 158 °F)
Storage	-40 ... +70 °C (-40 ... +158 °F)
<b>Enclosure rating</b>	
Remote sensor	IP68 to EN 60529/NEMA 6P, 10 mH <sub>2</sub> O cont.
Compact version	IP68 to EN 60529/NEMA 6P, 3 mH <sub>2</sub> O for six months
<b>Certificates and approvals</b>	
Calibration	
• Standard calibration	2 x 25 % and 2 x 90 % (default)
• Special calibration	5-point calibration: 20 %, 40 %, 60 %, 80 %, 100 % of factory Q <sub>max</sub> 10-point calibration: ascending and descending at 20 %, 40 %, 60 %, 80 %, 100 % of factory Q <sub>max</sub> Matched-pair calibration: default, 5-point, 10-point
Material certificate EN 10204-3.1	Available when ordering together with meter <sup>1)</sup>
Drinking water approvals	<ul style="list-style-type: none"> <li>• NSF/ANSI Standard 61<sup>2)</sup> (cold water) USA</li> <li>• WRAS (BS 6920 cold water) UK</li> <li>• ACS Listed France</li> <li>• DVGW W270 Germany</li> <li>• Belgaqua (B)</li> <li>• MCERTS (GB)</li> </ul>
Fire Service Approvals	FM Fire Service Meter (Class Number 1044) <sup>3)</sup>
Conformity	<ul style="list-style-type: none"> <li>• PED: 97/23EC<sup>4)</sup></li> </ul> For pressure/temperature curves see MAG 3100 on page 3/70. <ul style="list-style-type: none"> <li>• EMC: IEC/EN 61326</li> </ul>
<b>Sensor version</b>	DN 25 ... 1200 (1" ... 48")
<b>Sensor material</b>	Carbon steel ASTM A 105, with corrosion resistant two-component epoxy coating (150 µm/300 µm) Corrosivity category C4M, according to ISO 12944
<b>Measuring principle</b>	Electromagnetic induction
<b>Excitation frequency</b>	
Basic version	
• Battery-powered	DN 25 ... 150 (1" ... 6"): 1/15 Hz DN 200 ... 600 (8" ... 24"): 1/30 Hz DN 700 ... 1200 (28" ... 48"): 1/60 Hz
• Mains-powered	DN 25 ... 150 (1" ... 6"): 6.25 Hz DN 200 ... 600 (8" ... 24"): 3.125 Hz DN 700 ... 1200 (28" ... 48"): 1.5625 Hz



## MAG 8000 for abstraction and distribution network applications (7ME6810)

<b>Advanced version</b>	
• Battery-powered	DN 25 ... 150 (1" ... 6"): 1/15 Hz (adjustable up to 6.25 Hz; reduced battery lifetime) DN 200 ... 600 (8" ... 24"): 1/30 Hz (adjustable up to 3.125 Hz; reduced battery lifetime) DN 700 ... 1200 (28" ... 48"): 1/60 Hz (adjustable up to 1.5625 Hz; reduced battery lifetime)
• Mains-powered	DN 25 ... 150 (1" ... 6"): 6.25 Hz DN 200 ... 600 (8" ... 24"): 3.125 Hz DN 700 ... 1200 (28" ... 48"): 1.5625 Hz
<b>Flanges</b>	
EN 1092-1 (DIN 2501)	DN 25 and DN 40 (1" and 1½"): PN 40 (580 psi) DN 50 ... 150 (2" ... 6"): PN 16 (232 psi) DN 200 ... 1200 (8" ... 48"): PN 10 or PN 16 (145 psi or 232 psi)
ANSI 16.5 Class 150	1" ... 24": 20 bar (290 psi)
AWWA C-207	28" ... 48": PN 10 (145 psi)
AS 4087	DN 50 ... 1200 (2" ... 48"): PN 16 (232 psi)
<b>Liner</b>	EPDM
<b>Electrode and grounding electrodes</b>	Hastelloy C276/2.4819
<b>Grounding straps</b>	Grounding straps are premounted from the factory on each side of the sensor.

1) Has to be ordered with the meter. It is not possible to order the certificate afterwards.

2) Including Annex G

3) Not for sensors with 300 µm coating.

4) For further information on the PED standard and requirements see page 10/15.

# Flow Measurement

## SITRANS F M

### MAG 8000 for abstraction and distribution network applications (7ME6810)

3

Selection and Ordering data	Article No.
<b>SITRANS F M MAG 8000 water meter</b>	<b>7 ME 6 8 1 0 -</b>
<p>➤ Click on the Article No. for the online configuration in the PIA Life Cycle Portal.</p>	
<b>Diameter</b>	
DN 25 (1")	2 D
DN 40 (1½")	2 R
DN 50 (2")	2 Y
DN 65 (2½")	3 F
DN 80 (3")	3 M
DN 100 (4")	3 T
DN 125 (5")	4 B
DN 150 (6")	4 H
DN 200 (8")	4 P
DN 250 (10")	4 V
DN 300 (12")	5 D
DN 350 (14")	5 K
DN 400 (16")	5 R
DN 450 (18")	5 Y
DN 500 (20")	6 F
DN 600 (24")	6 P
DN 700 (28") <sup>1)</sup>	6 Y
DN 750 (30") <sup>1)</sup>	7 D
DN 800 (32") <sup>1)</sup>	7 H
DN 900 (36") <sup>1)</sup>	7 M
DN 1000 (40") <sup>1)</sup>	7 R
DN 1050 (42") <sup>1)</sup>	7 U
DN 1100 (44") <sup>1)</sup>	7 V
DN 1200 (48") <sup>1)</sup>	8 B
<b>Flange norm and pressure rating</b>	
EN 1092-1	
PN 10 (DN 200 ... 1200 (8" ... 48"))	B
PN 16 (DN 50 ... 1200 (2" ... 48"))	C
PN 16 non-PED (DN 700 ... 1200 (28" ... 48"))	D
PN 40 (DN 25 ... 40 (1" ... 1½"))	F
ANSI B16.5	
Class 150	J
AWWA C-207	
Class D (28" ... 48")	L
AS4087	
PN 16 (DN 50 ... 1200 (2" ... 48"))	N
<b>Sensor version</b>	
EPDM liner and Hastelloy electrodes, 150 µm coating	3
EPDM liner and Hastelloy electrodes, 300 µm coating	4
<b>Calibration</b>	
Standard ± 0.4 % of rate ± 2 mm/s	1
Extended ± 0.2 % of rate ± 2 mm/s DN 50... 300 (2" ... 12")	2
<b>Region version</b>	
Europe (m³, m³/h, 50 Hz)	1
USA (Gallon, GPM, 60 Hz)	2
Australia (MI, MI/d, 50 Hz)	3
<b>Transmitter type and installation</b>	
Basic version integral on sensor	A
Basic version, remote cables mounted on sensor with IP68/NEMA 6P plugs:	
• 5 m (16.4 ft)	B
• 10 m (32.8 ft)	C
• 20 m (65.6 ft)	D
• 30 m (98.4 ft)	E
Advanced version integral on sensor	K

Selection and Ordering data	Article No.
<b>SITRANS F M MAG 8000 water meter</b>	<b>7 ME 6 8 1 0 -</b>
<p>Advanced version, remote cables mounted on sensor with IP68/NEMA 6P plugs:</p> <ul style="list-style-type: none"> <li>• 5 m (16.4 ft)</li> <li>• 10 m (32.8 ft)</li> <li>• 20 m (65.6 ft)</li> <li>• 30 m (98.4 ft)</li> </ul>	
<b>Communication interface</b>	
No additional "add-on" communication module installed	A
Serial RS 485 with Modbus RTU (Terminated as end device)	B
Serial RS 232 with Modbus RTU	C
Encoder interface with Sensus protocol	D
GSM/GPRS communication module with remote antenna; 5 m (16.4 ft) cable	S
GSM/GPRS communication module with analog inputs and remote antenna; 5 m (16.4 ft) cable	T
<b>Power supply</b>	
Internal battery (no battery included)	0
Internal battery pack installed <sup>2)</sup>	1
Power cable (1.5 m (4.9 ft)) with IP68/NEMA 6P plugs for external battery (no battery included)	2
12/24 V AC/DC power supply with battery backup and 3 m (9.8 ft) power cable for external connection (no battery included)	3
115 ... 230 V AC power supply with battery backup and 3 m (9.8 ft) power cable for external connection (no battery included)	4
<p><sup>1)</sup> The Diameter DN 700 (28") to DN 1200 (48") is only available as remote transmitter type installation.</p> <p><sup>2)</sup> Lithium batteries are subject to special transportation regulations according to United Nations "Regulation of Dangerous Goods, UN 3090 and UN 3091". Special transport documentation is required to observe these regulations. This may influence both transport time and costs.</p> <p>➤ We can offer shorter delivery times for configurations designated with the Quick Ship Symbol. For details see page 10/11 in the appendix.</p>	
<b>Operating instructions for SITRANS F M MAG 8000</b>	
<b>Description</b>	Article No.
• English	A5E03071515
• German	A5E00740986
<p>All literature is available to download for free, in a range of languages, at <a href="http://www.siemens.com/processinstrumentation/documentation">www.siemens.com/processinstrumentation/documentation</a></p>	
<b>Operating instructions for MAG 8000 GSM/GPRS communication module</b>	
<b>Description</b>	Article No.
• English	A5E03644134

## MAG 8000 for abstraction and distribution network applications (7ME6810)

Selection and Ordering data	Order code	Selection and Ordering data	Order code
<b>Additional information</b>		<b>Additional information</b>	
Please add "-Z" to Article No. and specify Order code(s) and plain text.		Please add "-Z" to Article No. and specify Order code(s) and plain text.	
<b>Certificate</b>		<b>Certificate</b>	
Material certificate according to EN 10204-3.1	<b>C12<sup>1)</sup></b>	G x 1000	<b>L49</b>
<b>Special calibration</b>		CF x 1000	<b>L50</b>
5-point calibration for DN 15 ... DN 200 <sup>2)</sup>	<b>D01</b>	Al	<b>L51</b>
5-point calibration for DN 250 ... DN 600 <sup>2)</sup>	<b>D02</b>	kl	<b>L52</b>
5-point calibration for DN 700 ... DN 1200 <sup>2)</sup>	<b>D03</b>	BBL42 (US oil barrel, 1 barrel = 42 US gallons)	<b>L54</b>
10-point calibration for DN 15 ... DN 200 <sup>3)</sup>	<b>D06</b>	<b>Pulse set up</b>	
10-point calibration for DN 250 ... DN 600 <sup>3)</sup>	<b>D07</b>	(default pulse A = forward and pulse B = Alarm, pulse width = 50 ms)	
10-point calibration for DN 700 ... DN 1200 <sup>3)</sup>	<b>D08</b>	A function = RV, reverse flow	<b>L62</b>
Default (2 x 25 % and 2 x 90 %) match-pair calibration for DN 15 ... DN 200	<b>D11</b>	A function = FWnet, forward net flow	<b>L63</b>
Default (2 x 25 % and 2 x 90 %) match-pair calibration for DN 250 ... DN 600	<b>D12</b>	A function = RVnet, reverse net flow	<b>L64</b>
Default (2 x 25 % and 2 x 90 %) match-pair calibration for DN 700 ... DN 1200	<b>D13</b>	A function = Off	<b>L65</b>
5-point, matched-pair calibration for DN 15 ... DN 200 <sup>2)</sup>	<b>D15</b>	Volume per pulse A = x 0.0001 <sup>4)</sup>	<b>L70</b>
5-point, matched-pair calibration for DN 250 ... DN 600 <sup>2)</sup>	<b>D16</b>	Volume per pulse A = x 0.001 <sup>4)</sup>	<b>L71</b>
5-point, matched-pair calibration for DN 700 ... DN 1200 <sup>2)</sup>	<b>D17</b>	Volume per pulse A = x 0.01 <sup>4)</sup>	<b>L72</b>
10-point, matched-pair calibration for DN 15 ... DN 200 <sup>3)</sup>	<b>D18</b>	Volume per pulse A = x 0.1 <sup>4)</sup>	<b>L73</b>
10-point, matched-pair calibration for DN 250 ... DN 600 <sup>3)</sup>	<b>D19</b>	Volume per pulse A = x 1 <sup>4)</sup>	<b>L74</b>
10-point, matched-pair calibration for DN 700 ... DN 1200 <sup>3)</sup>	<b>D20</b>	B function = FW, forward flow	<b>L80</b>
<b>Flow unit</b>		B function = RV, reverse flow	<b>L81</b>
l/s	<b>L00</b>	B function = FWnet, forward net flow	<b>L82</b>
MGD	<b>L01</b>	B function = RVnet, reverse net flow	<b>L83</b>
CFS	<b>L02</b>	B function = Alarm	<b>L84</b>
l/min	<b>L03</b>	B function = Call up	<b>L85</b>
m <sup>3</sup> /min	<b>L04</b>	Volume per pulse B = x 0.0001 <sup>4)</sup>	<b>L90</b>
GPM	<b>L05</b>	Volume per pulse B = x 0.001 <sup>4)</sup>	<b>L91</b>
CFM	<b>L06</b>	Volume per pulse B = x 0.01 <sup>4)</sup>	<b>L92</b>
l/h	<b>L07</b>	Volume per pulse B = x 0.1 <sup>4)</sup>	<b>L93</b>
m <sup>3</sup> /h	<b>L08</b>	Volume per pulse B = x 1 <sup>4)</sup>	<b>L94</b>
GPH	<b>L09</b>	<b>Data logger set up (default month logging)</b>	
CFH	<b>L10</b>	DataloggerInterval = Daily	<b>M31</b>
GPS	<b>L11</b>	DataloggerInterval = Weekly	<b>M32</b>
MI/d	<b>L12</b>	<b>Factory mounted cables</b>	
m <sup>3</sup> /d	<b>L13</b>	5 m (16.4 ft) pulse cable A+B	<b>M81</b>
GPD	<b>L14</b>	5 m (16.4 ft) communication cable RS 232/RS 485 terminated as end device	<b>M82</b>
BBL42/s	<b>L15</b>	20 m (65.6 ft) pulse cable A+B	<b>M84</b>
BBL42/min	<b>L16</b>	20 m (65.6 ft) communication cable RS 232/RS 485 terminated as end device	<b>M85</b>
BBL42/h	<b>L17</b>	Cello 2 channel, input cable 3 m (9.84 ft) with Brad Harrison micro-change 3 way connector	<b>M87</b>
BBL42/d	<b>L18</b>	Cello 2 channel, input cable 5 m (16.4 ft) with MIL-C-26482 spec. connectors	<b>M89</b>
<b>Totalizer</b>		Encoder interface cable with connector for ITRON 200WP radio, length 25 ft	<b>M90</b>
Volume calculation (default totalizer 1 = forward and totalizer 2 = reverse)		Encoder interface cable with connector for ITRON 200WP radio, length 5 ft	<b>M91</b>
Totalizer 1 = RV, reverse flow	<b>L20</b>	SOFREL cable 2 m for LS42 data logger	<b>M92</b>
Totalizer 1 = NET, net flow	<b>L22</b>	SOFREL cable 2 m for LS-Flow data logger	<b>M97</b>
Totalizer 2 = FW, forward flow	<b>L30</b>	<b>FM Fire Service Approval</b>	
Totalizer 2 = NET, net flow	<b>L31</b>	(with ANSI B16.5 Class 150 flanges)	
<b>Volume unit</b>		DN 50, DN 80 and DN 100 (2", 3" and 4")	<b>P20</b>
m <sup>3</sup>	<b>L40</b>	DN 150 and DN 200 (6" and 8")	<b>P21</b>
MI	<b>L41</b>	DN 250 and DN 300 (10" and 12")	<b>P22</b>
G	<b>L42</b>	<b>Region/customer specific labels</b>	
AF	<b>L43</b>	KCC label (South Korea)	<b>W28</b>
l x 100	<b>L44</b>	DIN 43863 label <sup>1)</sup>	<b>H21</b>
m <sup>3</sup> x 100	<b>L45</b>	DIN 43863 label with SWM mark <sup>1)</sup>	<b>H22</b>
G x 100	<b>L46</b>	1) Under preparation	
CF x 100	<b>L47</b>	2) 20 %, 40 %, 60 %, 80 %, 100 % of factory Q <sub>max</sub>	
MG	<b>L48</b>	3) Ascending and descending at 20 %, 40 %, 60 %, 80 %, 100 % of factory Q <sub>max</sub>	
		4) Pulse width = 10 ms	

## Flow Measurement

### SITRANS F M

#### MAG 8000 CT for revenue and bulk metering (7ME6820)

#### Overview



#### Benefits

##### Approvals

- MI-001, OIML R 49/OIML R 49 MAA
- PTB K7.2
- FM Fire Service

##### Easy to install

- Compact or remote solution with factory mounted cable and customer setting from factory
- IP68/NEMA 6P enclosure. Sensor can be buried
- Flexible power supply - internal or external battery pack or mains power supply with battery back-up possibilities

##### Long-term stability/Low cost of ownership

- No moving parts in a robust construction means less wear and tear
- Basic and advanced transmitter versions with different optional add-on communication modules fulfil various customer requirements for high cost efficiency
- Bi-directional measurement with an outstanding low flow performance
- Up to 10 years maintenance-free operation in typical applications
- Insignificant pressure drop

##### Intelligent information, easy to access

- Advanced information on site
- Advanced statistics and diagnostics
- Connectable to common AMR systems

#### Technical specifications

Meter	
<b>Accuracy</b>	OIML R 49/OIML R 49 MAA for DN 50 ... DN 300 (2" ... 12"), Class I and II with turn down up to Q3/Q1 = 400 at Q2/Q1 = 1.6 MI-001 verification for DN 50 ... DN 600 (2" ... 24"), Class II with turn down ratio Q3/Q1 = 250, Q3/Q1 = 200 or Q3/Q1 = 160 at Q2/Q1 = 1.6 FM Fire Service for DN 50, DN 80, DN 100, DN 150, DN 200, DN 250, and DN 300 (2", 3", 4", 6", 8", 10", and 12") ± 1.5% (Q <sub>min</sub> to Q <sub>max</sub> )
<b>Low flow cut-off (default)</b>	0.25 %
<b>Media conductivity</b>	Clean water > 20 µs/cm
<b>Temperature</b>	
Ambient	-20 ... +60 °C (-4 ... +140 °F) MI-001: -25 ... +55 °C (-13 ... +131 °F)
Media	0.1 ... 50 °C (32 ... 122 °F)
Storage	-40 ... +70 °C (-22 ... +158 °F)
<b>Enclosure rating</b>	
Remote sensor	IP68 to EN 60529/NEMA 6P, 10 mH <sub>2</sub> O cont.
Compact version	IP68 to EN 60529/NEMA 6P, 3 mH <sub>2</sub> O for six months
<b>Certificates and approvals</b>	
Calibration (standard)	2 x 25 % and 2 x 90 %
Material certificate EN 10204 3.1	Available when ordering together with meter <sup>1)</sup>
Drinking water approvals	<ul style="list-style-type: none"> <li>• NSF/ANSI Standard 61<sup>2)</sup> (cold water) USA</li> <li>• WRAS (BS 6920 cold water) UK</li> <li>• ACS Listed France</li> <li>• DVGW W270 Germany</li> <li>• Belgaqua (B)</li> <li>• MCERTS (GB)</li> </ul>
Fire Service approval	FM Fire Service (1044) <sup>3)</sup>
Custody transfer approval	<ul style="list-style-type: none"> <li>• OIML R 49 and OIML R 49 MAA approval (DN 50 ... DN 300 (2" ... 12"))</li> <li>• MI-001 approval (DN 50 ... DN 600 (2" ... 24")) (DK-0200-MI-001-011)</li> <li>• PTB K7.2</li> </ul>
Conformity	<ul style="list-style-type: none"> <li>• CEN EN 14154, ISO 4064</li> <li>• PED: 2014/68/EU<sup>4)</sup></li> <li>• EMC: IEC/EN 61326</li> </ul>
<b>Sensor version</b>	DN 50 ... 600 (2" ... 24")
<b>Sensor material</b>	Carbon steel ASTM A 105, with corrosion resistant two-component epoxy coating (150 µm/300 µm) Corrosivity category C4M, according to ISO 12944
<b>Measuring principle</b>	Electromagnetic induction
<b>Excitation frequency</b>	
Basic version	
• Battery-powered	DN 50 ... 150 (2" ... 6"): 1/15 Hz DN 200 ... 600 (8" ... 24"): 1/30 Hz
• Mains-powered	DN 50 ... 150 (2" ... 6"): 6.25 Hz DN 200 ... 600 (8" ... 24"): 3.125 Hz

## MAG 8000 CT for revenue and bulk metering (7ME6820)


<b>Advanced version</b>	
• Battery-powered	DN 50 ... 150 (2" ... 6"): 1/15 Hz (adjustable up to 6.25 Hz; reduced battery lifetime) DN 200 ... 600 (8" ... 24"): 1/30 Hz (adjustable up to 3.125 Hz; reduced battery lifetime)
• Mains-powered	DN 50 ... 150 (2" ... 6"): 6.25 Hz DN 200 ... 600 (8" ... 24"): 3.125 Hz
<b>Flanges</b>	
EN 1092-1 (DIN 2501)	DN 50 ... 150 (2" ... 6"): PN 16 (232 psi) DN 200 ... 300 (8" ... 12"): PN 10 or PN 16 (145 psi or 232 psi) up to DN 600 (24") in preparation
ANSI 16.5 Class 150	2" ... 12": 20 bar (290 psi) up to DN 600 (24") in preparation
AWWA C-207	28" ... 48": PN 10 (145 psi)
AS 4087	DN 50 ... 300 (2" ... 12"): PN 16 (232 psi) up to DN 600 (24") in preparation
<b>Liner</b>	EPDM
<b>Electrode and grounding electrodes</b>	Hastelloy C276/2.4819
<b>Grounding straps</b>	Grounding straps are premounted from the factory on each side of the sensor

- 1) Has to be ordered with the meter. It is not possible to order the certificate afterwards.
- 2) Including Annex G
- 3) Not for sensors with 300 µm coating.
- 4) For further information on the PED standard and requirements see page 10/15.

3

**MAG 8000 CT (Revenue program) water meter type approval**

MAG 8000 CT program is type approved and verified according to international water meter standard OIML R 49. The custody transfer program is approved as Class I and Class II, for the sensor program from DN 50 to DN 300, at different Q3 and Q3/Q1. Q2/Q1 = 1.6 and follows OIML R 49 specification.

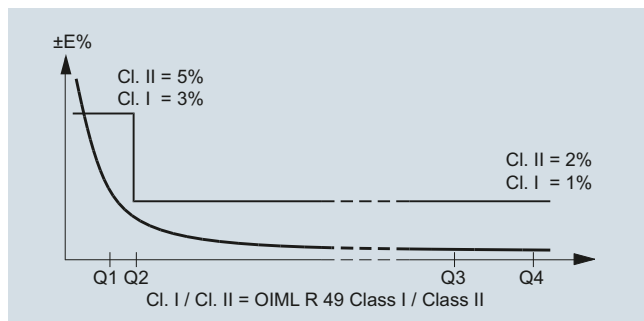**OIML R 49/2006-DK2-10.01 Revision 1 approval specification for Class I (1 %)<sup>1)</sup>**

Size	DN 50 (2")	DN 65 (2½")	DN 80 (3")	DN 100 (4")	DN 125 (5")	DN 150 (6")	DN 200 (8")	DN 250 (10")	DN 300 (12")	DN 350 (14")	DN 400 (16")	DN 450 (18")	DN 500 (20")	DN 600 (24")
„R“ Q3/Q1	250	250	250	250	250	250	250	250	125	-	-	-	-	-
Q1 [m³/h]	0.25	0.40	0.63	1.00	1.60	2.50	4.00	6.40	12.8	-	-	-	-	-
Q2 [m³/h]	0.40	0.64	1.00	1.60	2.60	4.00	6.40	10.24	20.48	-	-	-	-	-
<b>Q3 [m³/h]</b>	<b>63</b>	<b>100</b>	<b>160</b>	<b>250</b>	<b>400</b>	<b>630</b>	<b>1000</b>	<b>1600</b>	<b>1600</b>	-	-	-	-	-
Q4 [m³/h]	78.75	125	200	312.5	500	787.5	1250	2000	2000	-	-	-	-	-

**OIML R 49/2006-DK2-10.01 Revision 1 approval specification for Class II (2 %)<sup>1)</sup>**

Size	DN 50 (2")	DN 65 (2½")	DN 80 (3")	DN 100 (4")	DN 125 (5")	DN 150 (6")	DN 200 (8")	DN 250 (10")	DN 300 (12")	DN 350 (14")	DN 400 (16")	DN 450 (18")	DN 500 (20")	DN 600 (24")
„R“ Q3/Q1	400	400	400	400	400	400	400	400	200	-	-	-	-	-
Q1 [m³/h]	0.16	0.25	0.40	0.63	1.00	1.60	2.50	4.00	10.00	-	-	-	-	-
Q2 [m³/h]	0.25	0.40	0.63	1.00	1.60	2.50	4.00	6.40	16.00	-	-	-	-	-
<b>Q3 [m³/h]</b>	<b>63</b>	<b>100</b>	<b>160</b>	<b>250</b>	<b>400</b>	<b>630</b>	<b>1000</b>	<b>1600</b>	<b>1600</b>	-	-	-	-	-
Q4 [m³/h]	78.75	125	200	312.5	500	787.5	1250	2000	2000	-	-	-	-	-

<sup>1)</sup> The product will be delivered according to requested specifications, which may deviate from the specifications of the approval frame described in tables below.

## Flow Measurement

### SITRANS F M

#### MAG 8000 CT for revenue and bulk metering (7ME6820)

##### MAG 8000 CT (Revenue program) MI-001


MAG 8000 CT program is type approved according to international water meter standard OIML R 49. Since the first November 2006 the MI-001 water meter directive is in force, which means that all water meters can be sold across the EU borders if the water meters contain a MI-001 label.

The MAG 8000 CT MI-001 verified and labeled products are a Class II approval according to Directive 2014/32/EU of the European Parliament and Council of 26 February, 2014 on measuring instruments, Annex VI Thermal Energy Meters (MI-004) in the sizes from DN 50 to DN 400.

The MID certification is obtained as a B + D module approval according to the above mentioned directive.

Module B : Type approval according to OIML R 49

Module D : Quality insurance approval of production

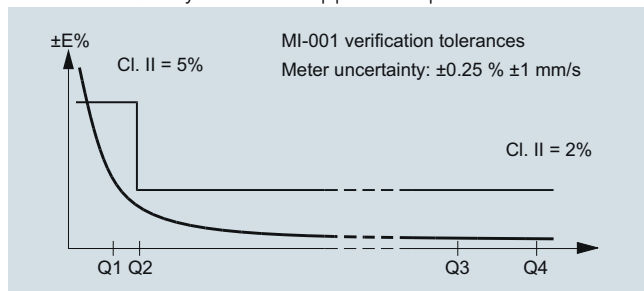

**MAG 8000 CT MI-001** verified and labeled products at a given  $Q3$  and  $Q4/Q3 = 1.25$  and  $Q2/Q1 = 1.6$  measuring ranges see below table:

7ME6820-xxxx1	DN 50 (2")	DN 65 (2½")	DN 80 (3")	DN 100 (4")	DN 125 (5")	DN 150 (6")	DN 200 (8")	DN 250 (10")	DN 300 (12")	DN 350 (14")	DN 400 (16")	DN 450 (18")	DN 500 (20")	DN 600 (24")
„R“ Q3/Q1	25	25	25	25	25	25	25	25	25	25	25	25	25	25
Q4 [m³/h]	20	31.25	50	78.75	125	200	312.5	500	787.5	1250	1250	1250	2000	3125
<b>Q3 [m³/h]</b>	<b>16</b>	<b>25</b>	<b>40</b>	<b>63</b>	<b>100</b>	<b>160</b>	<b>250</b>	<b>400</b>	<b>630</b>	<b>630</b>	<b>1000</b>	<b>1000</b>	<b>1600</b>	<b>1600</b>
Q2 [m³/h]	0.96	1.60	2.60	4.03	6.40	10.24	16	25.60	40.3	64	64	64	102.4	160
Q1 [m³/h]	0.60	1	1.60	2.52	4	6.40	10	16	25.2	40	40	40	64	100

7ME6820-xxxx2	DN 50 (2")	DN 65 (2½")	DN 80 (3")	DN 100 (4")	DN 125 (5")	DN 150 (6")	DN 200 (8")	DN 250 (10")	DN 300 (12")	DN 350 (14")	DN 400 (16")	DN 450 (18")	DN 500 (20")	DN 600 (24")
„R“ Q3/Q1	63	63	63	63	63	63	63	63	63	63	63	63	63	63
Q4 [m³/h]	20	31.25	50	78.75	125	200	312.5	500	750	1250	1250	3125	3125	5000
<b>Q3 [m³/h]</b>	<b>16</b>	<b>25</b>	<b>40</b>	<b>63</b>	<b>100</b>	<b>160</b>	<b>250</b>	<b>400</b>	<b>630</b>	<b>1000</b>	<b>1000</b>	<b>2500</b>	<b>2500</b>	<b>4000</b>
Q2 [m³/h]	0.41	0.63	1.02	1.60	2.54	4.06	6.35	10.16	16	25.4	25.4	63.49	63.49	101.6
Q1 [m³/h]	0.25	0.40	0.63	1	1.59	2.54	3.97	6.35	10	15.9	15.9	39.68	39.68	63.49

7ME6820-xxxx3	DN 50 (2")	DN 65 (2½")	DN 80 (3")	DN 100 (4")	DN 125 (5")	DN 150 (6")	DN 200 (8")	DN 250 (10")	DN 300 (12")	DN 350 (14")	DN 400 (16")	DN 450 (18")	DN 500 (20")	DN 600 (24")
„R“ Q3/Q1	80	80	80	80	80	80	80	80	80	80	80	80	80	80
Q4 [m³/h]	20	31.25	50	78.75	125	200	312.5	500	1250	2000	2000	5000	5000	7875
<b>Q3 [m³/h]</b>	<b>16</b>	<b>25</b>	<b>40</b>	<b>63</b>	<b>100</b>	<b>160</b>	<b>250</b>	<b>400</b>	<b>1000</b>	<b>1600</b>	<b>1600</b>	<b>4000</b>	<b>4000</b>	<b>6300</b>
Q2 [m³/h]	0.32	0.50	0.80	1.20	2	3.20	5	8	20	32	32	80	80	126
Q1 [m³/h]	0.20	0.31	0.50	0.75	1.25	2	3.13	5	12.50	20	20	50	50	78.75

7ME6820-xxxx4	DN 50 (2")	DN 65 (2½")	DN 80 (3")	DN 100 (4")	DN 125 (5")	DN 150 (6")	DN 200 (8")	DN 250 (10")	DN 300 (12")	DN 350 (14")	DN 400 (16")	DN 450 (18")	DN 500 (20")	DN 600 (24")
„R“ Q3/Q1	160	160	160	160	160	160	160	160	160	160	160	160	160	-
Q4 [m³/h]	50	78.75	125	200	312.5	500	787.5	1250	2000	2000	2000	7875	7875	-
<b>Q3 [m³/h]</b>	<b>40</b>	<b>63</b>	<b>100</b>	<b>160</b>	<b>250</b>	<b>400</b>	<b>630</b>	<b>1000</b>	<b>1600</b>	<b>1600</b>	<b>1600</b>	<b>6300</b>	<b>6300</b>	-
Q2 [m³/h]	0.40	0.63	1	1.60	2.50	4	6.30	10	16	16	16	63-	63	-
Q1 [m³/h]	0.25	0.39	0.63	1	1.56	2.50	3.94	6.25	10	10	10	39	39	-


7ME6820-xxxx5	DN 50 (2")	DN 65 (2½")	DN 80 (3")	DN 100 (4")	DN 125 (5")	DN 150 (6")	DN 200 (8")	DN 250 (10")	DN 300 (12")	DN 350 (14")	DN 400 (16")	DN 450 (18")	DN 500 (20")	DN 600 (24")
„R“ Q3/Q1	200	200	200	200	200	200	200	200	200	-	-	-	-	-
Q4 [m³/h]	50	78.75	125	200	312.5	500	787.5	1250	2000	-	-	-	-	-
<b>Q3 [m³/h]</b>	<b>40</b>	<b>63</b>	<b>100</b>	<b>160</b>	<b>250</b>	<b>400</b>	<b>630</b>	<b>1000</b>	<b>1600</b>	-	-	-	-	-
Q2 [m³/h]	0.32	0.50	0.80	1.28	2	3.20	5.04	8	12.8	-	-	-	-	-
Q1 [m³/h]	0.20	0.32	0.50	0.80	1.25	2	3.15	5	8	-	-	-	-	-



### MAG 8000 CT for revenue and bulk metering (7ME6820)

7ME6820- xxxx6	DN 50 (2")	DN 65 (2½")	DN 80 (3")	DN 100 (4")	DN 125 (5")	DN 150 (6")	DN 200 (8")	DN 250 (10")	DN 300 (12")	DN 350 (14")	DN 400 (16")	DN 450 (18")	DN 500 (20")	DN 600 (24")
„R“ Q3/Q1	250	250	250	250	250	250	250	250	-	-	-	-	-	-
Q4 [m³/h]	50	78.75	125	200	312.5	500	787.5	1250	-	-	-	-	-	-
<b>Q3 [m³/h]</b>	<b>40</b>	<b>63</b>	<b>100</b>	<b>160</b>	<b>250</b>	<b>400</b>	<b>630</b>	<b>1000</b>	-	-	-	-	-	-
Q2 [m³/h]	0.26	0.40	0.64	1.02	1.60	2.56	4	6.40	-	-	-	-	-	-
Q1 [m³/h]	0.16	0.25	0.40	0.64	1	1.60	2.52	4	-	-	-	-	-	-

The Label is placed on the side of the encapsulation.  
An example of the product label is shown below:

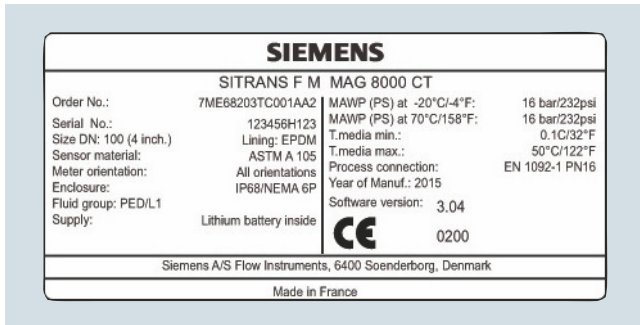

#### Installation conditions

Please refer to "System information SITRANS F M electromagnetic flowmeters".


#### Battery operation time and calculation

The battery operation time depends on the connected battery pack as well as the operation condition of the meter.

MAG 8000 calculates the remaining capacity every 4 hours and includes all consuming elements. Calculation compensates for temperature influence on battery capacity (drawing).

#### MAG 8000 CT (7ME6820) for Fire Service applications

MAG 8000 CT (7ME6820) is FM Fire Service approved for automatic fire protection systems according to the Fire Service Meters Standard, Class Number 1044. The approval is applicable for the sizes DN 50, DN 80, DN 100, DN 150, DN 200, DN 250, and DN 300 (2", 3", 4", 6", 8", 10", and 12") with ANSI B16.5 Class 150 flanges. The FM Fire Service approved product can be ordered via the Z-options P20, P21 and P22.

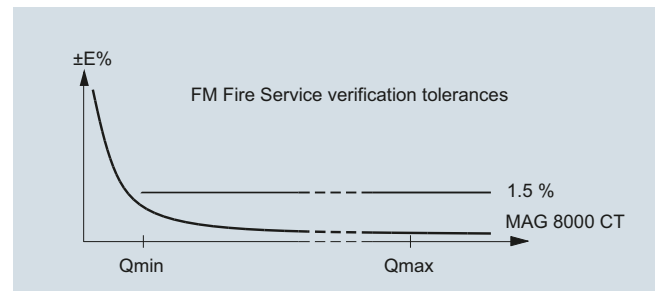

# Flow Measurement

## SITRANS F M

### MAG 8000 CT for revenue and bulk metering (7ME6820)

3

Selection and Ordering data	Article No.	Selection and Ordering data	Article No.
<b>SITRANS F M</b>		<b>SITRANS F M</b>	
<b>MAG 8000 CT water meter with EPDM liner and Hastelloy electrodes</b>	<b>7 ME 6 8 2 0 -</b>	<b>MAG 8000 CT water meter with EPDM liner and Hastelloy electrodes</b>	<b>7 ME 6 8 2 0 -</b>
<p>➤ Click on the Article No. for the online configuration in the PIA Life Cycle Portal.</p>			
<b>Diameter</b>		<b>Communication interface</b>	
DN 50 (2")	2 Y	No additional "add-on" communication module installed	A
DN 65 (2½")	3 F	Serial RS 485 with Modbus RTU (Terminated as end device)	B
DN 80 (3")	3 M	Serial RS 232 with Modbus RTU	C
DN 100 (4")	3 T	Encoder interface for ITRON 200WP radio with "Sensus" protocol	D
DN 125 (5")	4 B	GSM/GPRS communication module with remote antenna; 5 m (16.4 ft) cable	S
DN 150 (6")	4 H	GSM/GPRS communication module with analog inputs and remote antenna; 5 m (16.4 ft) cable	T
DN 200 (8")	4 P		
DN 250 (10")	4 V		
DN 300 (12")	5 D	<b>Power supply</b>	
DN 350 (14") <sup>1)</sup>	5 K	Internal battery (no battery included)	0
DN 400 (16") <sup>1)</sup>	5 R	Internal battery pack installed <sup>2)</sup>	1
DN 450 (18") <sup>1)</sup>	5 Y	Power cable (1.5 m (4.9 ft)) with IP68/NEMA 6P plugs for external battery (no battery included)	2
DN 500 (20") <sup>1)</sup>	6 F	12/24 V AC/DC power supply with battery backup and 3 m (9.8 ft) power cable for external connection (no battery included)	3
DN 600 (24") <sup>1)</sup>	6 P	115 ... 230 V AC power supply with battery backup and 3 m (9.8 ft) power cable for external connection. (no battery included)	4
<b>Flange norm and pressure rating</b>			
<u>EN 1092-1</u>			
PN 16	C		
<u>ANSI B16.5</u>	J		
Class 150	N		
<u>AS4087</u>			
PN 16			
<b>Sensor version</b>			
EPDM liner and Hastelloy electrodes, 150 µm coating	0		
EPDM liner and Hastelloy electrodes, 300 µm coating	4		
<b>Approval/Verification<sup>3)</sup></b>			
Without verification according to OIML R 49 <sup>4)</sup>	0		
MI-001 Q3/Q1 = 25	1		
MI-001 Q3/Q1 = 63	2		
MI-001 Q3/Q1 = 80	3		
MI-001 Q3/Q1 = 160	4		
MI-001 Q3/Q1 = 200	5		
MI-001 Q3/Q1 = 250	6		
Without verification calibrated to OIML R 49-Class II (Q3/Q1 = 100)	7		
Without verification calibrated to OIML R 49-Class II (Q3/Q1 = 250)	8		
<b>Region version</b>			
Europe (m <sup>3</sup> , m <sup>3</sup> /h, 50 Hz)	1		
USA (m <sup>3</sup> , m <sup>3</sup> /h, 60 Hz)	2		
<b>Transmitter type and installation</b>			
Basic version integral on sensor	A		
Basic version, remote cables mounted on sensor with IP68/NEMA 6P plugs			
5 m (16.4 ft)	B		
10 m (32.8 ft)	C		
20 m (65.6 ft)	D		
30 m (98.4 ft)	E		
Advanced version integral on sensor	K		
Advanced version, remote cables mounted on sensor with IP68/NEMA 6P plugs			
5 m (16.4 ft)	L		
10 m (32.8 ft)	M		
20 m (65.6 ft)	N		
30 m (98.4 ft)	P		

**Communication interface**

No additional "add-on" communication module installed

Serial RS 485 with Modbus RTU (Terminated as end device)

Serial RS 232 with Modbus RTU

Encoder interface for ITRON 200WP radio with "Sensus" protocol

GSM/GPRS communication module with remote antenna; 5 m (16.4 ft) cable

GSM/GPRS communication module with analog inputs and remote antenna; 5 m (16.4 ft) cable

**Power supply**

Internal battery (no battery included)

Internal battery pack installed<sup>2)</sup>

Power cable (1.5 m (4.9 ft)) with IP68/NEMA 6P plugs for external battery (no battery included)

12/24 V AC/DC power supply with battery backup and 3 m (9.8 ft) power cable for external connection (no battery included)

115 ... 230 V AC power supply with battery backup and 3 m (9.8 ft) power cable for external connection. (no battery included)

<sup>1)</sup> Under preparation.

<sup>2)</sup> Lithium batteries are subject to special transportation regulations according to United Nations "Regulation of Dangerous Goods, UN 3090 and UN 3091". Special transport documentation is required to observe these regulations. This may influence both transport time and costs.

<sup>3)</sup> For more details and references of the ranges please see the tables on pages 3/127 to 3/129.

<sup>4)</sup> Standard calibration or according to FM Fire Service requirements if P20, P21 or P22 is selected as Z option.

**Operating instructions for SITRANS F M MAG 8000**

Description	Article No.
• English	<b>A5E03071515</b>
• German	<b>A5E00740986</b>

All literature is available to download for free, in a range of languages, at [www.siemens.com/processinstrumentation/documentation](http://www.siemens.com/processinstrumentation/documentation)

**Operating instructions for MAG 8000 GSM/GPRS communication module**

Description	Article No.
• English	<b>A5E03644134</b>

## MAG 8000 CT for revenue and bulk metering (7ME6820)

Selection and Ordering data	Order code	Selection and Ordering data	Order code
<b>Additional information</b>		<b>Additional information</b>	
Please add "-Z" to Article No. and specify Order code(s) and plain text.		Please add "-Z" to Article No. and specify Order code(s) and plain text.	
Material certificate according to EN 10204-3.1	<b>C12<sup>1)</sup></b>	<b>Region/customer specific label</b>	
FP2E marking (France only)	<b>C17</b>	KCC label (South Korea)	<b>W28</b>
<b>Totalizer</b>		FP2E label (France)	<b>H20</b>
Volume calculation (default totalizer 1 = forward and totalizer 2 = reverse)		DIN 43863 label <sup>1)</sup>	<b>H21</b>
Totalizer 1 = RV, reverse flow	<b>L20</b>	DIN 43863 label with SWM mark <sup>1)</sup>	<b>H22</b>
Totalizer 1 = NET, net flow	<b>L22</b>		
Totalizer 2 = FW, forward flow	<b>L30</b>		
Totalizer 2 = NET, net flow	<b>L31</b>		
<b>Pulse set up</b>			
(default pulse A = forward and pulse B = Alarm, pulse width = 50 ms)			
A function = RV, reverse flow	<b>L62</b>		
A function = FWnet, forward net flow	<b>L63</b>		
A function = RVnet, reverse net flow	<b>L64</b>		
A function = Off	<b>L65</b>		
Volume per pulse A = x 0.001 <sup>2)</sup>	<b>L71</b>		
Volume per pulse A = x 0.01 <sup>2)</sup>	<b>L72</b>		
Volume per pulse A = x 0.1 <sup>2)</sup>	<b>L73</b>		
Volume per pulse A = x 1 <sup>2)</sup>	<b>L74</b>		
B function = FW, forward flow	<b>L80</b>		
B function = RV, reverse flow	<b>L81</b>		
B function = FWnet, forward net flow	<b>L82</b>		
B function = RVnet, reverse net flow	<b>L83</b>		
B function = Alarm	<b>L84</b>		
B function = Call up	<b>L85</b>		
Volume per pulse B = x 0.001 <sup>2)</sup>	<b>L91</b>		
Volume per pulse B = x 0.01 <sup>2)</sup>	<b>L92</b>		
Volume per pulse B = x 0.1 <sup>2)</sup>	<b>L93</b>		
Volume per pulse B = x 1 <sup>2)</sup>	<b>L94</b>		
<b>Data logger set up (default month logging)</b>			
DataloggerInterval = Daily	<b>M31</b>		
DataloggerInterval = Weekly	<b>M32</b>		
<b>Factory mounted cables</b>			
5 m (16.4 ft) pulse cable A+B	<b>M81</b>		
5 m (16.4 ft) communication cable RS 232/RS 485 terminated as end device	<b>M82</b>		
20 m (65.6 ft) pulse cable A+B	<b>M84</b>		
20 m (65.6 ft) communication cable RS 232/RS 485 terminated as end device	<b>M85</b>		
Cello 2 channel, input cable 3 m (9.84 ft) with Brad Harrison micro-change 3 way connector	<b>M87</b>		
Cello 2 channel, input cable 5 m (16.4 ft) with MIL-C-26482 spec. connectors	<b>M89</b>		
5 ft. Encoder interface cable with connector for ITRON 200WP radio	<b>M91</b>		
25 ft. Encoder interface cable with connector for ITRON 200WP radio	<b>M90</b>		
SOFREL cable 2 m for LS42 data logger	<b>M92</b>		
SOFREL cable 2 m for LS-Flow data logger	<b>M97</b>		
<b>FM Fire Service Approval</b>			
(with ANSI B16.5 Class 150 flanges)			
DN 50, DN 80 and DN 100 (2", 3" and 4")	<b>P20</b>		
DN 150 and DN 200 (6" and 8")	<b>P21</b>		
DN 250 and DN 300 (10" and 12")	<b>P22</b>		

- <sup>1)</sup> Under preparation  
<sup>2)</sup> Pulse width = 10 ms

## Flow Measurement

### SITRANS F M

#### MAG 8000 for irrigation applications (7ME6880)

#### Overview



<b>Temperature</b>	
Ambient	-20 ... +60 °C (-4 ... +140 °F)
Media	0 ... 70 °C (32 ... 158 °F)
Storage	-40 ... +70 °C (-40 ... +158 °F)
<b>Enclosure rating</b>	
Remote sensor	IP68 to EN 60529/NEMA 6P, 10 mH <sub>2</sub> O cont.
Compact version	IP68 to EN 60529/NEMA 6P, 3 mH <sub>2</sub> O for six months
<b>Approvals</b>	
Drinking water approvals	<ul style="list-style-type: none"> <li>• ANSI/NSF 61<sup>1)</sup> (cold water) USA</li> <li>• WRAS (BS 6920 cold water) UK</li> </ul>
Custody transfer approval	NMI M 10 Australia (DN 50 to DN 1200)
<b>Sensor material</b>	
Carbon steel ASTM A 105, with corrosion resistant two-component epoxy coating (150 µm/300 µm) Corrosivity category C4M, according to ISO 12944	
<b>Conformity</b>	
IEC/EN 61326	
<b>Flanges</b>	
EN 1092-1 (DIN 2501) PN 10 drilled pattern	DN 50 ... 600 (2" ... 24") (max. pressure 7 bar (101.5 psi))
ANSI 16.5 Class 150 drilled pattern	2" ... 24" (max. pressure 7 bar (101.5 psi))
AS 2091-1 Table D drilled pattern	DN 50 ... 600 (2" ... 24") (max. pressure 7 bar (101.5 psi))
AS 2129 Table E	DN 25, DN 40, DN 125 (1", 1½", 5")
AS 4087 PN 16	DN 50 ... DN 1200 (2" ... 48")
<b>Excitation frequency</b>	
Battery-powered	DN 50 ... 600 (2" ... 24"): 1/15 Hz DN 700 ... 1200 (28" ... 48"): 1/60 Hz
Mains-powered	DN 50 ... 600 (2" ... 24"): 3.125 Hz DN 700 ... 1200 (28" ... 48"): 1.5625 Hz
<b>Liner</b>	
Ebonite	
<b>Electrodes</b>	
Stainless steel AISI 316Ti/1.4571	

<sup>1)</sup> Including Annex G

#### Benefits

- IP68/NEMA 6P rating with tamper proof
- Flexible power supply - internal or external battery pack or mains power supply with battery back-up possibilities
- No moving parts in a robust construction means less wear and tear
- Up to 8 years maintenance-free operation in typical application
- Connectable to AMR systems
- Adaptor for conduit installation to provide a clean, protected pathway for device cables

#### Technical specifications

<b>Meter</b>	
<b>Accuracy</b>	± 0.8 % ± 2.5 mm/s ± 0.4 % ± 2.5 mm/s NMI (class 2.5)
<b>Low flow cut-off (default)</b>	1.0 %
<b>Media conductivity</b>	Clean water > 20 µs/cm

#### NMI M 10 measuring range

7ME6880	DN 25 (1")	DN 40 (1½")	DN 50 (2")	DN 65 (2½")	DN 80 (3")	DN 100 (4")	DN 125 (5")	DN 150 (6")	DN 200 (8")	DN 250 (10")	DN 300 (12")	DN 350 (14")
„R“ Q3/Q1	10	10	10	10	10	10	10	10	10	10	10	10
Q4 [m <sup>3</sup> /h]	11.25	28.75	43.75	75	112.5	175	275	375	687.5	750	1625	2125
<b>Q3 [m<sup>3</sup>/h]</b>	<b>9</b>	<b>23</b>	<b>35</b>	<b>60</b>	<b>90</b>	<b>140</b>	<b>220</b>	<b>300</b>	<b>550</b>	<b>600</b>	<b>1300</b>	<b>1700</b>
Q1 [m <sup>3</sup> /h]	0.9	2.3	3.5	6	9	14	22	30	55	60	130	170

7ME6880	DN 400 (16")	DN 450 (18")	DN 500 (20")	DN 600 (24")	DN 700 (28")	DN 750 (30")	DN 800 (32")	DN 900 (36")	DN 1000 (40")	DN 1050 (42")	DN 1100 (44")	DN 1200 (48")
„R“ Q3/Q1	10	10	10	10	10	10	10	10	10	10	10	10
Q4 [m <sup>3</sup> /h]	2125	2250	2250	2250	4375	4375	5000	5000	5000	5000	5000	5000
<b>Q3 [m<sup>3</sup>/h]</b>	<b>1700</b>	<b>1800</b>	<b>1800</b>	<b>1800</b>	<b>3500</b>	<b>3500</b>	<b>4000</b>	<b>4000</b>	<b>4000</b>	<b>4000</b>	<b>4000</b>	<b>4000</b>
Q1 [m <sup>3</sup> /h]	170	180	180	180	350	350	400	400	400	400	400	400

Selection and Ordering data	Article No.	Selection and Ordering data	Article No.
<b>SITRANS F M MAG 8000 water meter including factory-mounted grounding rings</b>	<b>7 ME 6 8 8 0 -</b>	<b>SITRANS F M MAG 8000 water meter including factory-mounted grounding rings</b>	<b>7 ME 6 8 8 0 -</b>
↗ Click on the Article No. for the online configuration in the PIA Life Cycle Portal.			
<b>Diameter</b>		<b>Communication interface</b>	
DN 25 (1")	2 D	No additional "add-on" communication module installed	A
DN 40 (1½")	2 R	Serial RS 485 with Modbus RTU (Terminated as end device)	B
DN 50 (2")	2 Y	Serial RS 232 with Modbus RTU	C
DN 65 (2½")	3 F	Encoder interface	D
DN 80 (3")	3 M	GSM module with remote antenna and 5 m (16.4 ft) cable	S
DN 100 (4")	3 T	GSM module with analog input, remote antenna and 5 m (16.4 ft) cable	T
DN 125 (5")	4 B		
DN 150 (6")	4 H	<b>Power supply</b>	
DN 200 (8")	4 P	Internal battery (no battery included)	0
DN 250 (10")	4 V	Internal battery pack installed 2 D-cell <sup>1) 2)</sup>	1
DN 300 (12")	5 D	Power cable (1.5 m (4.9 ft) with IP68/NEMA 6P plugs for external battery (no battery included)	2
DN 350 (14")	5 K	12/24 V AC/DC power supply with battery backup and 3 m (9.8 ft) power cable for external connection (no battery included)	3
DN 400 (16")	5 R	115 ... 230 V AC power supply with battery backup and 3 m (9.8 ft) power cable for external connection (no battery included)	4
DN 450 (18")	5 Y	Internal battery pack installed 1 D-cell <sup>1) 2)</sup>	5
DN 500 (20")	6 F		
DN 600 (24")	6 P		
DN 700 (28")	6 Y		
DN 750 (30")	7 D		
DN 800 (32")	7 H		
DN 900 (36")	7 M		
DN 1000 (40")	7 R		
DN 1050 (42")	7 U		
DN 1100 (44")	7 V		
DN 1200 (48")	8 B		
<b>Flange norm and pressure rating</b>		<b>Operating instructions for SITRANS F M MAG 8000</b>	
EN 1092-1 drilled pattern PN 10/max. 7 bar (101 psi)	B	<b>Description</b>	Article No.
ANSI B16.5 drilled pattern CI 150/max. 7 bar (101 psi)	J	• English	<b>A5E03071515</b>
AS2129 drilled pattern table D/max. 7 bar (101 psi)	M	• German	<b>A5E00740986</b>
AS2129 table E (DN 25, DN 40, DN 125)	G		
AS4087 PN 16 (DN 50 ... DN 1200)	N	All literature is available to download for free, in a range of languages, at <a href="http://www.siemens.com/processinstrumentation/documentation">www.siemens.com/processinstrumentation/documentation</a>	
<b>Sensor version</b>			
Ebonite liner and stainless steel electrodes	4		
<b>Calibration</b>			
± 0.8 %, ± 2.5 mm/s	0		
± 0.4 %, ± 2.5 mm/s	1		
NMI (2.5 %)	3		
<b>Region version</b>			
Europe (m <sup>3</sup> , m <sup>3</sup> /h, 50 Hz)	1		
USA (Gallon, GPM, 60 Hz)	2		
Australia (MI, MI/d, 50 Hz)	3		
<b>Transmitter type and installation</b>			
Basic version integral on sensor	A		
Basic version, remote cables mounted on sensor with IP68/NEMA 6P plugs			
2 m (6.56 ft)	T		
5 m (16.4 ft)	B		
10 m (32.8 ft)	C		
20 m (65.6 ft)	D		
30 m (98.4 ft)	E		

## Flow Measurement

### SITRANS F M


#### MAG 8000 for irrigation applications (7ME6880)

Selection and Ordering data	Order code	Selection and Ordering data	Order code
<b>Additional information</b>		<b>Additional information</b>	
Please add “-Z” to Article No. and specify Order code(s) and plain text.		Please add “-Z” to Article No. and specify Order code(s) and plain text.	
<u>Flow unit</u>		<u>Volume per pulse B = x 0.0001<sup>1)</sup></u>	
I/s	<b>L00</b>	Volume per pulse B = x 0.001 <sup>1)</sup>	<b>L90</b>
MGD	<b>L01</b>	Volume per pulse B = x 0.01 <sup>1)</sup>	<b>L91</b>
CFS	<b>L02</b>	Volume per pulse B = x 0.1 <sup>1)</sup>	<b>L92</b>
I/min	<b>L03</b>	Volume per pulse B = x 0.1 <sup>1)</sup>	<b>L93</b>
m <sup>3</sup> /min	<b>L04</b>	Volume per pulse B = x 1 <sup>1)</sup>	<b>L94</b>
GPM	<b>L05</b>	<u>Device operation</u>	
CFM	<b>L06</b>	Only operator menu activated	<b>M11</b>
I/h	<b>L07</b>	<u>Data logger set up</u> (default month logging)	
m <sup>3</sup> /h	<b>L08</b>	DataloggerInterval = Daily	<b>M31</b>
GPH	<b>L09</b>	DataloggerInterval = Weekly	<b>M32</b>
CFH	<b>L10</b>	<u>Factory mounted cables</u>	
GPS	<b>L11</b>	5 m (16.4 ft) pulse cable A+B	<b>M81</b>
MI/d	<b>L12</b>	5 m (16.4 ft) communication cable RS 232/RS 485 terminated as end device	<b>M82</b>
m <sup>3</sup> /d	<b>L13</b>	20 m (65.6 ft) pulse cable A+B	<b>M84</b>
GPD	<b>L14</b>	20 m (65.6 ft) communication cable RS 232/RS 485 terminated as end device	<b>M85</b>
<u>Totalizer</u>		Cello 2 channel, input cable 3 m (9.84 ft) with Brad Harrison micro-change 3 way connector	<b>M87</b>
Volume calculation (default totalizer 1= forward and totalizer 2 = reverse)		Cello 2 channel, input cable 5 m (16.4 ft) with MIL-C-26482 spec. connectors	<b>M89</b>
Totalizer 1 = RV, reverse flow	<b>L20</b>	5 ft Encoder interface cable with connector for ITRON 200WP radio	<b>M91</b>
Totalizer 1 = NET, net flow	<b>L22</b>	25 ft Encoder interface cable with connector for ITRON 200WP radio	<b>M90</b>
Totalizer 2 = FW, forward flow	<b>L30</b>	SOFREL cable 2 m for LS42 data logger	<b>M92</b>
Totalizer 2 = NET, net flow	<b>L31</b>	SOFREL cable 2 m for LS-Flow data logger	<b>M97</b>
<u>Volume unit</u>		Adaptors for conduit installation	<b>M94</b>
m <sup>3</sup>	<b>L40</b>		
MI	<b>L41</b>		
G	<b>L42</b>		
AF	<b>L43</b>		
I x 100	<b>L44</b>		
m <sup>3</sup> x 100	<b>L45</b>		
G x 100	<b>L46</b>		
CF x 100	<b>L47</b>		
MG	<b>L48</b>		
G x 1000	<b>L49</b>		
CF x 1000	<b>L50</b>		
AI	<b>L51</b>		
kl	<b>L52</b>		
<u>Pulse set up</u>			
(default pulse A = forward and pulse B = Alarm, pulse width = 50 ms)			
A function = RV, reverse flow	<b>L62</b>		
A function = FWnet, forward net flow	<b>L63</b>		
A function = RVnet, reverse net flow	<b>L64</b>		
A function = Off	<b>L65</b>		
Volume per pulse A = x 0.0001 <sup>1)</sup>	<b>L70</b>		
Volume per pulse A = x 0.001 <sup>1)</sup>	<b>L71</b>		
Volume per pulse A = x 0.01 <sup>1)</sup>	<b>L72</b>		
Volume per pulse A = x 0.1 <sup>1)</sup>	<b>L73</b>		
Volume per pulse A = x 1 <sup>1)</sup>	<b>L74</b>		
Pulse A pulse width 5 ms (volume per pulse x 1)	<b>L75</b>		
Pulse A pulse width 10 ms (volume per pulse x 1)	<b>L76</b>		
Pulse A pulse width 50 ms (volume per pulse x 1)	<b>L77</b>		
Pulse A pulse width 100 ms (volume per pulse x 1)	<b>L78</b>		
Pulse A pulse width 500 ms (volume per pulse x 1)	<b>L79</b>		
B function = FW, forward flow	<b>L80</b>		
B function = RV, reverse flow	<b>L81</b>		
B function = FWnet, forward net flow	<b>L82</b>		
B function = RVnet, reverse net flow	<b>L83</b>		
B function = Alarm	<b>L84</b>		
B function = Call up	<b>L85</b>		

<sup>1)</sup> Pulse width = 10 ms



## Dimensional drawings

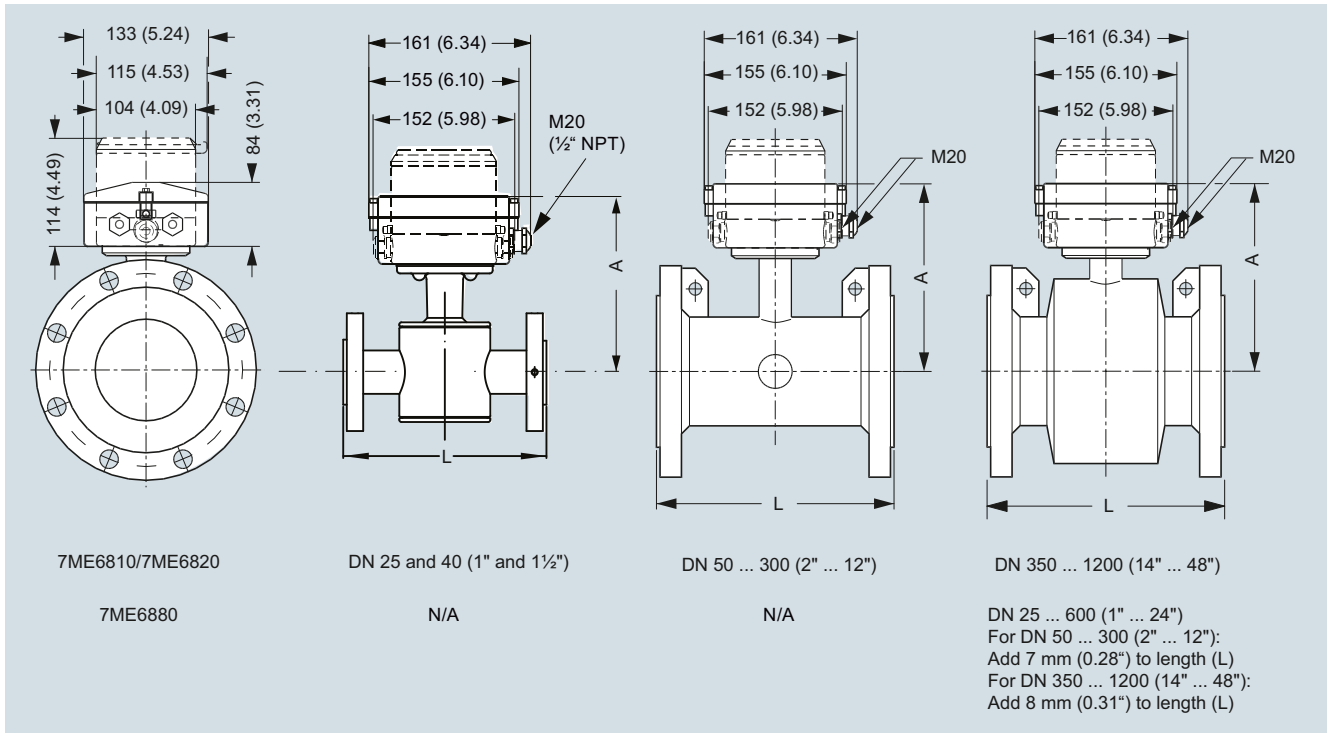

Dimensions in mm (inch)

Nominal DN size	A	L, lengths <sup>1)</sup>							Weight <sup>2)</sup>	
		EPDM (7ME6810 and 7ME6820)	EN 1092-1 PN 10	EN 1092-1 PN 16/ PN 16 non-PED	EN 1092-1 PN 40	ANSI 16.5 Class 150	AS 4087 PN 16	AWWA C-207 Class D	AS 2129 Table E	kg
mm (inch)	mm (inch)	mm	mm	mm	inch	mm	mm	mm		
25 (1)	188 (7.4)	-	-	200	7.9	200	-	200	6	13
40 (1½)	203 (8.0)	-	-	200	7.9	200	-	200	9	20
50 (2)	178 (7.0)	-	200	-	7.9	200	-	-	11	25
65 (2½)	181 (7.1)	-	200	-	7.9	200	-	-	13	29
80 (3)	191 (7.5)	-	200	-	7.9	200	-	-	15	34
100 (4)	197 (7.8)	-	250	-	9.8	250	-	-	17	38
125 (5)	210 (8.3)	-	250	-	9.8	250	-	250	22	50
150 (6)	224 (8.8)	-	300	-	11.8	300	-	-	28	63
200 (8)	249 (9.8)	350	350	-	13.8	350	-	-	50	113
250 (10)	276 (10.9)	450	450	-	17.7	450	-	-	71	160
300 (12)	303 (11.9)	500	500	-	19.7	500	-	-	88	198
350 (14)	365 (14.4)	550	550	-	21.7	550	-	-	127	279
400 (16)	391 (15.4)	600	600	-	23.6	600	-	-	145	318
450 (18)	421 (16.6)	600	600	-	23.6	600	-	-	175	384
500 (20)	447 (17.6)	600	600	-	26.8	600	-	-	225	494
600 (24)	497 (19.6)	600	600	-	32.3	600	-	-	340	747
700 (28)	548 (21.6)	700	875/700	-	N/A	700	700	-	316	694
750 (30)	573 (22.6)	N/A	N/A	-	N/A	N/A	750	-	N/A	N/A
800 (32)	603 (23.7)	800	1000/800	-	N/A	800	800	-	398	1045
900 (36)	656 (25.8)	900	1125/900	-	N/A	900	900	-	476	1045
1000 (40)	708 (27.9)	1000	1250/1000	-	N/A	1000	1000	-	602	1322
1050 (42)	708 (27.9)	N/A	N/A	-	N/A	N/A	1050	-	N/A	N/A
1100 (44)	759 (29.9)	N/A	N/A	-	N/A	N/A	1100	-	N/A	N/A
1200 (48)	814 (32.0)	1200	1500/1200	-	N/A	1200	1200	-	887	1996

<sup>1)</sup> Tolerances on built-in length:

DN 15 to DN 200 (½" to 8"): +0/-3 mm (+0/-0.12"), DN 250 to DN 400 (10" to 16"): +0/-5 mm (+0/-0.20"),

DN 450 to DN 600 (18" to 24"): +5/-5 mm (+0.20/-0.20"), DN 700 to DN 1200 (28" to 48"): +10/-10 mm (+0.39/-0.39")


<sup>2)</sup> For remote version the sensor weight is reduced with 2 kg (4.5 lb)

## Flow Measurement

### SITRANS F M


#### Battery-operated water meter MAG 8000

##### Remote version

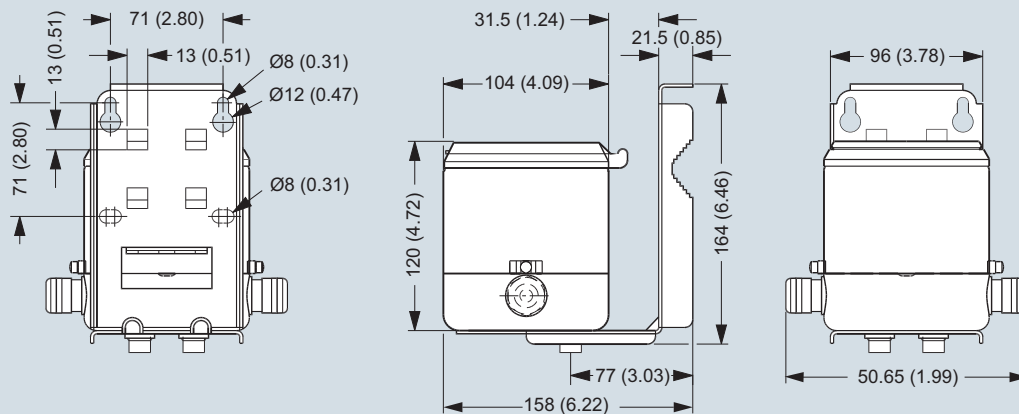

Dimensions in mm (inch), weight 3.5 kg (8 lb)


##### External battery pack

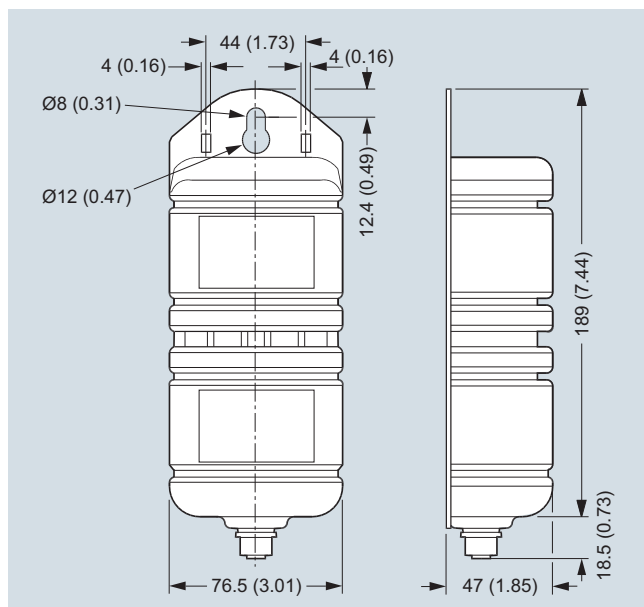

Dimensions in mm (inch), weight 2.0 kg (4.5 lb)

Battery pack has to be mounted in upwards position to ensure maximum battery capacity.

##### Grounding rings

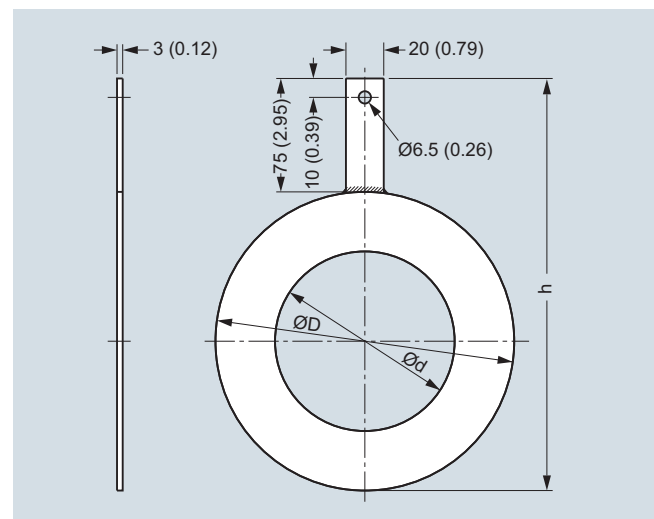


Dimensions in mm (inch) for grounding rings MAG 8000 with EPDM lining (7ME6810 and 7ME6820) DN 25 to DN 300

Dimension	Internal diameter (d)	Outside diameter (D)	h
DN 25	27	68	143
DN 40	38	88	163
DN 50	52	100	175
DN 65	64	120	195
DN 80	79	133	208
DN 100	95	158	233
DN 125	115	188	263
DN 150	145	216	291
DN 200	193	268	343
DN 250	246	324	399
DN 300	295	374	449


**Schematics**

Electrical installation and pulse output – Connection diagram

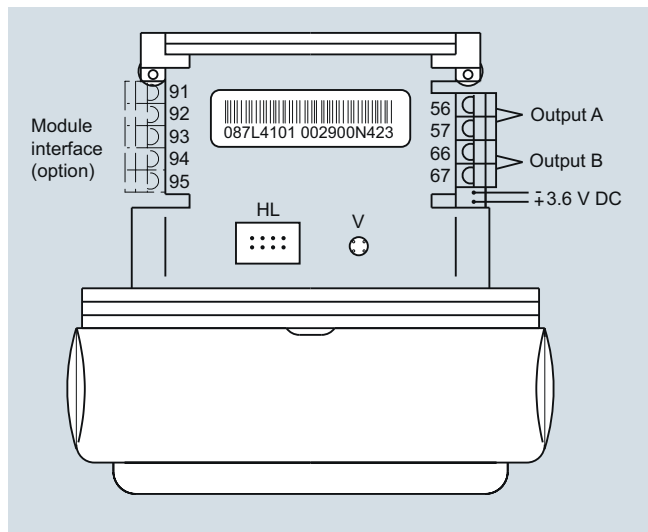

HL = Hardware lock key connection  
V = Push button for verification mode


Pulse wire connection

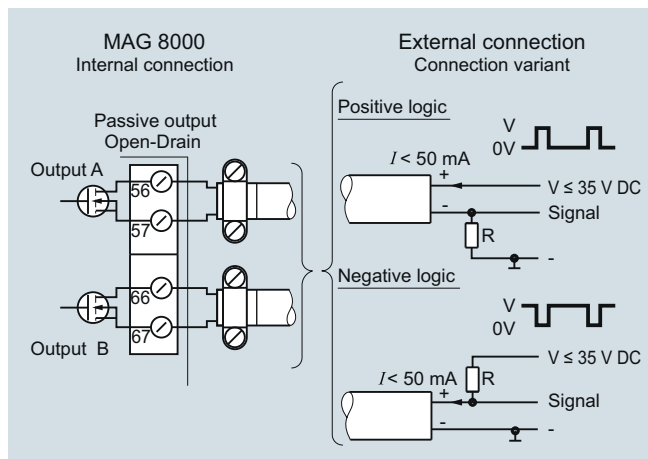

The pulse output can be configured as volume, alarm or call-up. The output can be connected as positive or negative logic. R = pull up/down is selected in relation to the Vx power supply and with a max. current I of 50 mA.

Use shielded cable to avoid EMC problems. Make sure the shield is correctly mounted under the cable clamp (no pig tail).

Electrical installation of GSM/GPRS module

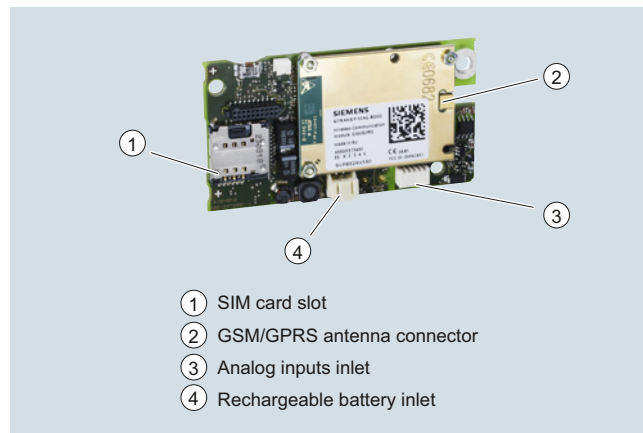










- ① SIM card slot
- ② GSM/GPRS antenna connector
- ③ Analog inputs inlet
- ④ Rechargeable battery inlet








## Flow Measurement

### SITRANS F M

#### Battery-operated water meter MAG 8000

##### Accessories

Description	Article No.	
PC Flow Tool on CD (Download for free from <a href="http://www.siemens.com/flow">www.siemens.com/flow</a> )	<b>FDK:087L6001</b>	
IrDA infrared interface adapter with USB for data acquisition with 1.2 m (3.9 ft) cable	◆ <b>FDK:087L4163</b>	
Battery backup for mains power supply, 1 pc. D-cell (3.6 V, 16.5 Ah) <sup>1)</sup>	◆ <b>A5E03354392</b>	
Rechargeable Lithium battery for MAG 8000 GSM/GPRS communication module <sup>1)</sup>	◆ <b>A5E03436686</b>	
Internal battery pack, one set of 2 D-cell (3.6 V, 33 Ah) and accessories for replacement <sup>1)</sup> , incl. NBR O-ring	◆ <b>FDK:087L4150</b>	
External battery pack IP68/NEMA 6P with connector, 4 D-cell (3.6 V, 66 Ah) <sup>1)</sup> . Order cable FDK:087L4152 separately.	◆ <b>FDK:087L4151</b>	
Mains power supply 12 ... 24 V AC/DC (average power consumption during line ≤ 0.1 VA) with battery backup and 3 m (9.8 ft) power cable for external connection (no battery included) Temperature range: Fixed laying: -40 ... +90 °C (-40 ... +194 °F) Flexible application: -30 ... +80 °C (-22 ... +176 °F)	<b>FDK:087L4210</b>	
Mains power supply 115 ... 230 V AC, 50/60 Hz, with battery backup up and 3 m (9.8 ft) power cable for external connection (no battery included)	◆ <b>FDK:087L4211</b>	
RS 232 add-on module, point to point communication interface with Modbus RTU protocol	<b>FDK:087L4212</b>	
RS 485 add-on module, multidrop communication interface with Modbus RTU protocol	<b>FDK:087L4213</b>	
Encoder interface module, with "Sensus" protocol for ITRON 200WP and 100W radio	<b>A5E02475650</b>	
MAG 8000 GSM/GPRS communication module. Rechargeable battery, antenna and analog cable input must be ordered separately	<b>A5E03412758</b>	

Description	Article No.	
One cable entry 2 ... 5 mm (0.08 ... 0.20 ") M12 brass glands with M20 reduction <sup>2)</sup> , package of 10 pcs, for GSM module antenna cable, power cable of external battery pack, encoder card cable	<b>FDK:087L4154</b>	
One cable entry 6 ... 8 mm (0.24 ... 0.31 ") M20 brass glands package <sup>2)</sup> (10 pcs), for pulse output cable or Modbus cable, Cello cable or mains power supply	<b>FDK:087L4155</b>	
One cable entry 8 ... 11 mm (0.31 ... 0.43 ") M20 brass glands package <sup>2)</sup> (10 pcs), for SOFREL cable	<b>FDK:087L4156</b>	
One cable entry 11 ... 15 mm (0.43 ... 0.59 ") M20 brass glands package <sup>2)</sup> (10 pcs)	<b>FDK:087L4157</b>	
Two cable entries 3.5 ... 5 mm (0.14 ... 0.20 ") M20 brass glands package <sup>2)</sup> (10 pcs)	<b>FDK:087L4158</b>	
Two cable entries 5.5 ... 7.5 mm (0.22 ... 0.30 ") M20 brass glands package <sup>2)</sup> (10 pcs)	<b>FDK:087L4159</b>	
High gain antenna for MAG 8000 GSM/GPRS (PVC, IP68, cable length 5 m (16.4 ft), with SMA male connector (type RG 58) and internal SMA to SMP female cable adapter, and single entry cable gland)	◆ <b>A5E03436689</b>	
Analog input cable for MAG 8000 GSM/GPRS (3 m (9.8 ft) cable with M12 connector A-Coding female 5 pins, and two-entry cable gland)	<b>A5E03436698</b>	
Potting kit for terminal box of flow sensors for IP68/NEMA 6P	◆ <b>FDK:085U0220</b>	
MAG 8000 Hardware key to access protected parameters	◆ <b>FDK:087L4165</b>	
MAG 8000 demo - training unit pack operating on Alkaline batteries. Transmitter with Flow tool CD, IrDA interface adapter and hardware key (No dangerous goods limitations)	<b>FDK:087L4080</b>	

## Battery-operated water meter MAG 8000

Description	Article No.
Alkaline battery for MAG 8000 demo transmitter (3 V 13 Ah) (No dangerous goods limitations)	<b>FDK:087L4142</b>



◆ We can offer shorter delivery times for configurations designated with the Quick Ship Symbol ◆. For details see page 10/11 in the appendix.

<sup>1)</sup> Lithium batteries are subject to special transportation regulations according to United Nations "Regulation of Dangerous Goods, UN 3090 and UN 3091". Special transport documentation is required to observe these regulations. This may influence both transport time and costs.

<sup>2)</sup> For cable connection through MAG 8000 transmitter bottom part.

When MAG 8000 (7ME6810 and 7ME6820) is installed in PVC or coated pipelines, grounding rings must be installed additionally.

Grounding rings, type C must be used for the 7ME6810 and 7ME6820 routes (sizes > DN 300). Please see grounding rings in the section MAG 3100 Grounding rings and be aware that the mentioned MLFB codes include only 1 grounding ring. Grounding rings DN 25 to DN 300 in stainless steel are packed in pairs and sold as a "grounding ring kit".

Dimension	Article No.
DN 25	<b>A5E01002946</b>
DN 40	<b>A5E01002947</b>
DN 50	<b>A5E01002948</b>
DN 65	<b>A5E01002950</b>
DN 80	<b>A5E01002952</b>
DN 100	<b>A5E01002953</b>
DN 125	<b>A5E01002954</b>
DN 150	<b>A5E01002955</b>
DN 200	<b>A5E01002957</b>
DN 250	<b>A5E01002958</b>
DN 300	<b>A5E01002962</b>



## Spare parts

Description	Article No.
MAG 8000 transmitter compact replacement kit <sup>1)</sup> . No battery included. With blank product label. System number specified by ordering.	<b>FDK:087L4166</b>
MAG 8000 transmitter remote replacement kit <sup>1)</sup> . No battery included. With blank product label. System number specified by ordering.	<b>FDK:087L4202</b>
MAG 8000 (Advanced version) transmitter compact replacement kit <sup>1)</sup> . No battery included. With blank product label. No system number required.	<b>FDK:087L4203</b>



Description	Article No.
MAG 8000 (Advanced version) transmitter remote replacement kit <sup>1)</sup> . No battery included. No system number required.	<b>FDK:087L4204</b>
MAG 8000 (Basic version) transmitter PCB replacement kit <sup>1)</sup> . No system number required.	<b>A5E01171569</b>
MAG 8000 (Advanced version) transmitter PCB replacement kit <sup>1)</sup> . No system number required.	<b>FDK:087L4168</b>
Enclosure top including plastic lid, screws, O-ring and blank product label	<b>FDK:087L4167</b>
Power cable (1.5 m (4.9 ft)) with IP68/NEMA 6P plugs for external battery (no battery included); PE jacket, ambient temperature: -20 ... +60 °C (-4 ... +140 °F)	<b>FDK:087L4152</b>
5 ft. Encoder interface cable with IP68/NEMA 6P plugs included, for ITRON 200WP and 100W radio; 22 AWG stranded TC conductors, polypropylene insulation, twisted pair, overall Beldfoil shield, 22 AWG stranded TC drain wire, PVC jacket	<b>A5E02551263</b>
25 ft. Encoder interface cable with IP68/NEMA 6P plugs included, for ITRON 200WP radio; 22 AWG stranded TC conductors, polypropylene insulation, twisted pair, overall Beldfoil shield, 22 AWG stranded TC drain wire, PVC jacket	<b>A5E02551182</b>



## Flow Measurement

### SITRANS F M

#### Battery-operated water meter MAG 8000

Description	Article No.	
Service tool kit package with various component for service and replacement. Content: 10 plastic top lids 20 screws 10 wire holders 10 battery cups 10 greased O-rings 20 clamp kits 10 IrDA adaptor holding rings	<b>FDK:087L4162</b>	
Remote cable set 5 m (16.4 ft) with IP68/NEMA 6P plugs - PG 13.5 <sup>2)</sup>	<b>FDK:087L4108</b>	
Remote cable set 5 m (16.4 ft) with IP68/NEMA 6P plugs - M20	<b>A5E00862482</b>	
Remote cable set 10 m (32.8 ft) with IP68/NEMA 6P plugs - PG 13.5 <sup>2)</sup>	<b>FDK:087L4109</b>	
Remote cable set 10 m (32.8 ft) with IP68/NEMA 6P plugs - M20	<b>A5E00862487</b>	
Remote cable set 20 m (65.6 ft) with IP68/NEMA 6P plugs - PG 13.5 <sup>2)</sup>	<b>FDK:087L4110</b>	
Remote cable set 20 m (65.6 ft) with IP68/NEMA 6P plugs - M20	<b>A5E00862492</b>	
Remote cable set 30 m (98.4 ft) with IP68/NEMA 6P plugs - PG 13.5 <sup>2)</sup>	<b>FDK:087L4111</b>	
Remote cable set 30 m (98.4 ft) with IP68/NEMA 6P plugs - M20	<b>A5E00862497</b>	
10 m cable set with pre-mounted conduit adaptor	<b>A5E33400834</b>	
20 m cable set with pre-mounted conduit adaptor	<b>A5E33400836</b>	

<sup>1)</sup> Not applicable to custody transfer (CT) verified systems without re-verification

<sup>2)</sup> For sensors produced before October 2007.

MAG 8000 (7ME6880) grounding ring service kit, consisting of 2 pcs. grounding rings (AISI 304/1.4301), screws and gaskets

Dimension	Article No.	
<b>Drilled pattern flanges (7 bar)</b>		
DN 50 2"	<b>A5E03082907</b>	
DN 65 2½"	<b>A5E03082908</b>	
DN 80 3"	<b>A5E03082909</b>	
DN 100 4"	<b>A5E03082910</b>	
DN 125 5"	<b>A5E03082911</b>	
DN 150 6"	<b>A5E32877967</b>	
DN 200 8"	<b>A5E03082913</b>	
DN 250 10"	<b>A5E03082914</b>	
DN 300 12"	<b>A5E03082915</b>	
DN 350 14"	<b>A5E03082916</b>	
DN 400 16"	<b>A5E03082917</b>	
DN 450 18"	<b>A5E03082918</b>	
DN 500 20"	<b>A5E03082919</b>	
DN 600 24"	<b>A5E03082920</b>	
<b>AS 2191 table E flanges</b>		
DN 25 1"	<b>A5E33474999</b>	
DN 40 1½"	<b>A5E33475000</b>	
DN 125 5"	<b>A5E33475006</b>	
<b>AS 4087 PN 16 flanges</b>		
DN 50 2"	<b>A5E33475001</b>	
DN 65 2½"	<b>A5E33475002</b>	
DN 80 3"	<b>A5E33475003</b>	
DN 100 4"	<b>A5E33475004</b>	
DN 150 6"	<b>A5E33475007</b>	
DN 200 8"	<b>A5E33475008</b>	
DN 250 10"	<b>A5E33475009</b>	
DN 300 12"	<b>A5E33475010</b>	
DN 350 14"	<b>A5E33475011</b>	
DN 400 16"	<b>A5E33475012</b>	
DN 450 18"	<b>A5E34240921</b>	
DN 500 20"	<b>A5E33475013</b>	
DN 600 24"	<b>A5E33475014</b>	
DN 700 28"	<b>A5E33414889</b>	
DN 800 32"	<b>A5E33414890</b>	
DN 900 36"	<b>A5E33414891</b>	
DN 1000 40"	<b>A5E33414892</b>	
DN 1200 48"	<b>A5E33414893</b>	

