

Temperature Measurement

Transmitters for mounting in sensor head

SITRANS TH100 (Pt100)

Overview



The SITRANS TH100 dispenses with electrical isolation and universal sensor connection to provide a low-cost alternative for Pt100 measurements.

For the parameterization, the SIPROM T software is used in combination with the modem for SITRANS TH100/TH200.

Its extremely compact design makes the SITRANS TH100 ideal for the retrofitting of measuring points or for the use of analog transmitters.

The transmitter is available as a non-Ex version as well as for use in potentially explosive atmospheres.

Benefits

- Two-wire transmitter
- Assembly in connection head type B (DIN 43729) or larger, or on a standard DIN rail
- Can be programmed, which means that the sensor connection, measuring range, etc. can also be programmed
- Intrinsically-safe version for use in potentially explosive areas

Application

Used in conjunction with Pt100 resistance thermometers, the SITRANS TH100 transmitters are ideal for measuring temperatures in all industries. Due to its compact size it can be installed in the connection head type B (DIN 43729) or larger.

The output signal is a direct current from 4 to 20 mA that is proportional to the temperature.

Parameterization is implemented over the PC using the parameterization software SIPROM T and the modem for SITRANS TH100/TH200. If you already have a "modem for SITRANS TK" (Article No. 7NG3190-6KB), you can continue using this to parameterize the SITRANS TH100.

Transmitters of the "intrinsically-safe" type of protection can be installed within potentially explosive atmospheres. The devices comply with the Directive 2014/34/EU (ATEX), as well as FM and CSA regulations.


Function

Mode of operation

The measured signal supplied by a Pt100 resistance thermometer (2, 3 or 4-wire system) is amplified in the input stage. The voltage, which is proportional to the input variable, is then converted into digital signals by a multiplexer in an analog/digital converter. They are converted in the microcontroller in accordance with the sensor characteristics and further parameters (measuring range, damping, ambient temperature etc.).

The signal prepared in this way is converted in a digital/analog converter into a load-independent direct current of 4 to 20 mA.

An EMC filter protects the input and output circuits against electromagnetic interferences.

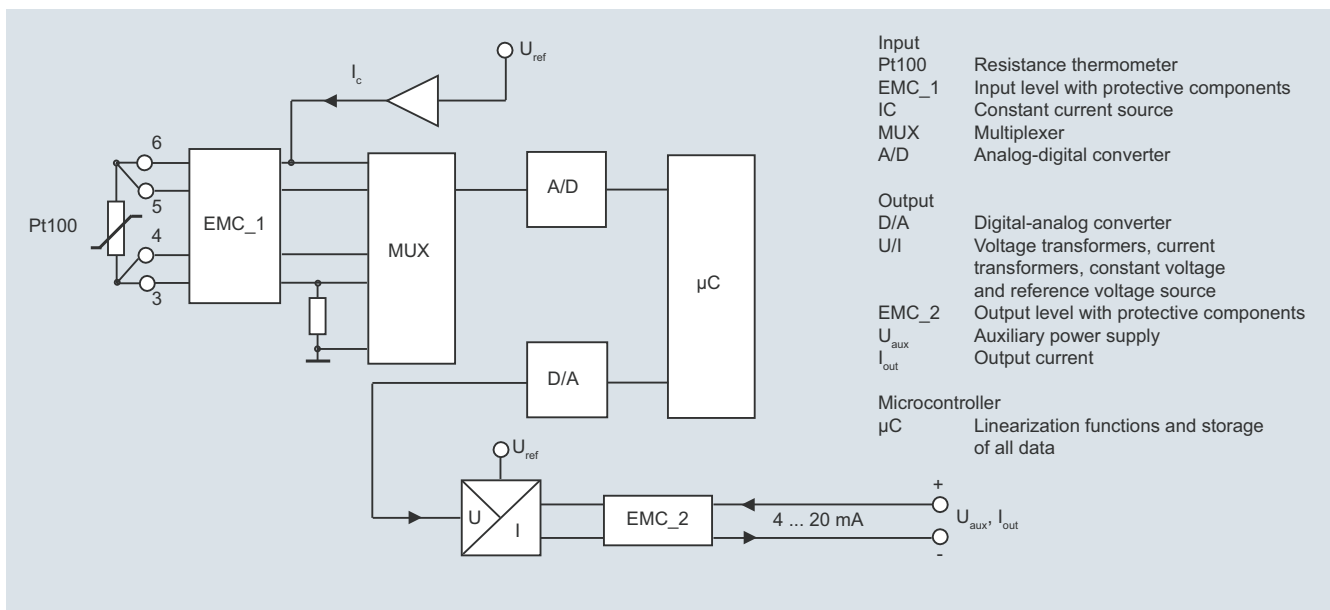

SITRANS TH100, function diagram

Temperature Measurement

Transmitters for mounting in sensor head

SITRANS TH100 (Pt100)

Technical specifications

Input		Construction	
Resistance thermometer		Weight	50 g
Measured variable	Temperature	Dimensions	See dimensional drawing
Sensor type	PT100 to IEC 60751	Material	Molded plastic
Characteristic curve	Temperature-linear	Cross-section of cables	Max. 2.5 mm ² (AWG 13)
Type of connection	2-, 3- or 4-wire circuit	Degree of protection to IEC 60529	
Resolution	14 bit	• Enclosure	IP40
Measuring accuracy		• Terminals	IPO0
• Span <250 °C (450 °F)	< 0.25 °C (0.45 °F)	Certificates and approvals	
• Span >250 °C (450 °F)	< 0.1 % of span	Explosion protection ATEX	
Repeatability	< 0.1 °C (0.18 °F)	EC type test certificate	PTB 05 ATEX 2049X
Measuring current	approx. 0.4 mA	• "Intrinsic gas safety" type of protection	II 1 G Ex ia IIC T6/T4 II (1) 2 G Ex ib [ia Ga] IIC T6/T4 Gb II (1) 3 G Ex ic [ia Ga] IIC T6/T4 Gc II 3 G Ex ic IIC T6/T4 Gc
Measuring cycle	< 0.7 s	• "Non-sparking" type of protection	II 3 G Ex nA IIC T6/T4 Gc II 3 G Ex nA[ic] IIC T6/T4 Gc
Measuring range	-200 ... +850 °C -328 ... +1562 °F)	• "Intrinsic dust safety" type of protection	II 1 D Ex ia IIC T115 °C Da
Measuring span	25 ... 1050 °C (77 ... 1922 °F)	Explosion protection FM for USA	
Unit	°C or °F	• FM approval	FM 3024169
Offset	programmable: -100 ... +100 °C (-180 ... +180 °F)	• Degree of protection	IS / CI I, II, III / Div 1 / GP ABCDEFG T6, T5, T4 CI I / ZN 0 / AEx ia IIC T6, T5, T4 NI / CI I / Div 2 / GP ABCDFG T6, T5, T4 NI / CI I / ZN 2 / IIC T6, T5, T4
Line resistance	Max. 20 Ω (total from feeder and return conductor)	Explosion protection FM for Canada (cFM _{US})	
Noise rejection	50 and 60 Hz	• FM approval	FM 3024169C
Output		• Degree of protection	IS / CI I, II, III / Div 1 / GP ABCDEFG T6, T5, T4 NI / CI I / DIV 2 / GP ABCD T6, T5, T4 NIFW / CI I, II, III / DIV 2 / GP ABCDFG T6, T5, T4 DIP / CI II, III / Div 2 / GP FG T6, T5, T4 CI I / ZN 0 / Ex ia IIC T6, T5, T4 CI I / ZN 2 / Ex nA nL IIC T6, T5, T4
Output signal	4 ... 20 mA, two-wire	Other certificates	EAC Ex(GOST), NEPSI
Auxiliary power	8.5 ... 36 V DC (30 V for Ex ia and ib; 32 V for Ex nL/ic; 35 V for Ex nA)	Software requirements for SIPROM T	
Max. load	(U _{aux} - 8.5 V)/0.023 A	PC operating system	
Overrange	3.6 ... 23 mA, infinitely adjustable (default range: 3.84 ... 20.5 mA)	Windows ME, 2000, XP, Win 7 and Win 8; can also be used in connection with RS 232 modem under Windows 95, 98 and 98SE	
Error signal (following sensor fault) (conforming to NE43)	3.6 ... 23 mA, infinitely adjustable (default range: 3.6 mA or 22.8 mA)		
Damping time	0 ... 30 s (default value: 0 s)		
Protection	Against reversed polarity		
Resolution	12 bit		
Accuracy at 23 °C (73.4 °F)	< 0.1 % of span		
Temperature effect	< 0.1 %/10 °C (0.1 %/18 °F)		
Effect of auxiliary power	< 0.01 % of span/V		
Effect of load impedance	< 0.025 % of max. span/100 Ω		
Long-term drift	• < 0.025 % of the max. span in the first month • < 0.035 % of the max. span after one year • < 0.05 % of the max. span after 5 years		
Ambient conditions			
Ambient temperature range	-40 ... +85 °C (-40 ... +185 °F)		
Storage temperature range	-40 ... +85 °C (-40 ... +185 °F)		
Relative humidity	98 %, with condensation		
Electromagnetic compatibility	According to EN 61326 and NAMUR NE21		

Temperature Measurement

Transmitters for mounting in sensor head

SITRANS TH100 (Pt100)

Selection and Ordering data

Article No.

SITRANS TH100 temperature transmitters for Pt100

for installation in connection head, type B (DIN 43729), two-wire system, 4 ... 20 mA, programmable, without electrical isolation

- Without explosion protection ▶ ◆ **7NG3211-0NN00**
- With explosion protection "Intrinsic safety" type of protection and for zone 2
 - to ATEX ▶ ◆ **7NG3211-0AN00**
 - to FM (cFM_{US}) ▶ ◆ **7NG3211-0BN00**

Further designs

Order code

Add **"-Z"** to Article No. and specify Order code(s)

Test report (5 measuring points)

C11

Customer-specific programming

Add **"-Z"** to Article No. and specify Order code(s)

Measuring range to be set

Specify in plain text (max. 5 digits):

Y01: ... to ... °C, °F

Y01¹⁾

Measuring point no. (TAG), max. 8 characters

Y17²⁾

Measuring point descriptor, max. 16 characters

Y23²⁾

Pt100 (IEC) 2-wire, $R_L = 0 \Omega$

U02³⁾

Pt100 (IEC) 3-wire

U03³⁾

Pt100 (IEC) 4-wire

U04³⁾

Special differing customer-specific programming, specify in plain text

Y09⁴⁾

Fail-safe value 3.6 mA (instead of 22,8 mA)

U36²⁾

Accessories

Further accessories for assembly, connection and transmitter configuration, see page 2/188.

Article No.

Modem for SITRANS TH100, TH200, TR200 and TF with TH200 incl. SIPROM T parameterization software ▶

7NG3092-8KU

With USB connection

DIN rail adapters for head transmitters ▶

7NG3092-8KA

(Quantity delivered: 5 units)

Connecting cable

7NG3092-8KC

4-wire, 150 mm, for sensor connections when using head transmitters in the high hinged cover (set with 5 units)

▶ Available ex stock.

◆ We can offer shorter delivery times for configurations designated with the Quick Ship Symbol ◆. For details see page 10/11 in the appendix.

1) For customer-specific programming for RTD and TC, the start value and the end value of the required measuring span must be specified here.

2) For this selection, Y01 or Y09 must also be selected.

3) For this selection, Y01 must also be selected.

4) For customer-specific programming, for example mV and ohm, the start value and the end value of the required measuring span and the unit must be entered here.

Supply units see Chapter "Supplementary Components".

Ordering example

7NG3211-0NN00-Z Y01+Y23+U03


Y01: -10 ... +100 °C

Y23: TICA1234HEAT

Factory setting:


- Pt100 (IEC 751) with 3-wire circuit
- Measuring range: 0 ... 100 °C (32 ... 212 °C)
- Error signal in the event of sensor breakage: 22.8 mA
- Sensor offset: 0 C (0 °F)
- Damping 0.0 s

Dimensional drawings

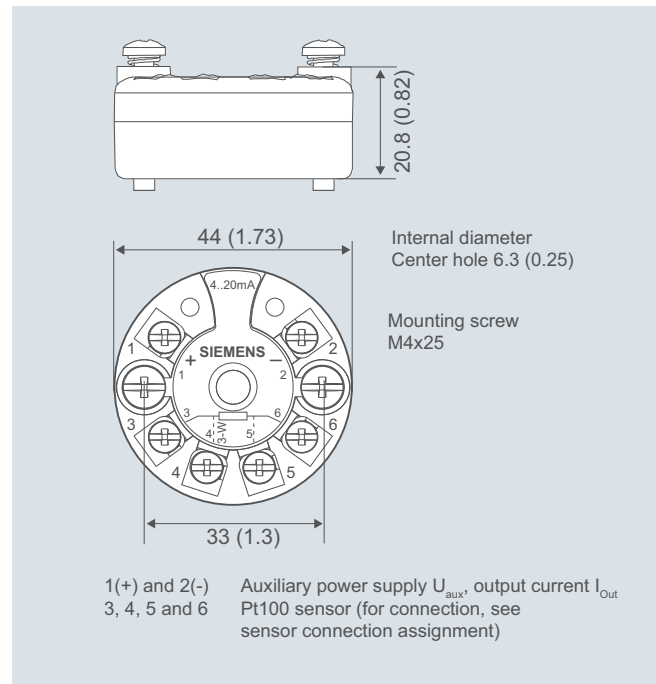


SITRANS TH100, dimensions in mm (inch)

Mounting on DIN rail

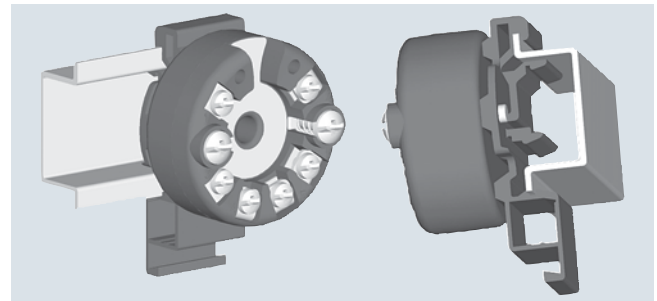


SITRANS TH100, mounting of transmitter on DIN rail

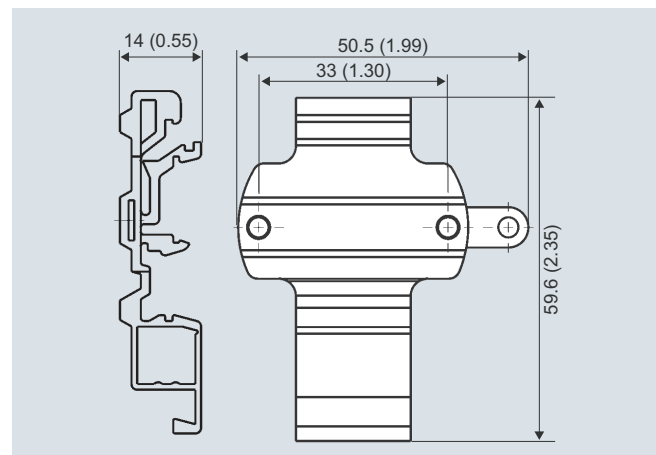

DIN rail adaptor, dimensions in mm (inch)

Schematics

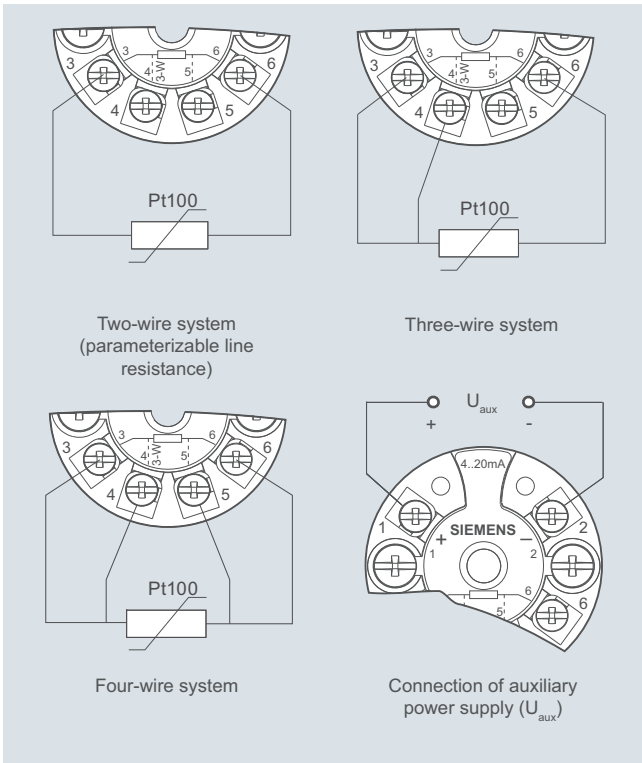

SITRANS TH100, sensor connection assignment

Temperature Measurement

Transmitters for mounting in sensor head

SITRANS TH200 (Universal)

Overview



Ultra flexible - with the universal SITRANS TH200 transmitter

- Two-wire devices for 4 to 20 mA
- Mounting in the connection head of the temperature sensor
- Universal input for virtually any type of temperature sensor
- Configurable over PC

Benefits

- Compact design
- Flexible mounting and center hole allow you to select your preferred type of installation
- Electrically isolated
- Test sockets for multimeters
- Diagnostics LED (green/red)
- Sensor monitoring open circuits and short-circuits
- Self-monitoring
- Configuration status stored in EEPROM
- SIL2 (with Order code C20), SIL2/3 (with C23)
- Expanded diagnostic functions, such as slave pointer, operating hours counter, etc.
- Special characteristic
- Electromagnetic compatibility to EN 61326 and NE21

Application

SITRANS TH200 transmitters can be used in all industrial sectors. Due to their compact size they can be installed in the connection head type B (DIN 43729) or larger. The following sensors/signal sources can be connected over their universal input module:

- Resistance thermometers (2, 3 or 4-wire system)
- Thermocouples
- Resistance-based sensors and DC voltage sources

The output signal is a direct current from 4 to 20 mA in accordance with the sensor characteristic.


Transmitters of the "intrinsically safe" type of protection can be installed within potentially explosive atmospheres. The devices comply with the Directive 2014/34/EU (ATEX), as well as FM and CSA regulations.

Function

The SITRANS TH200 is configured over a PC. A USB or RS 232 modem is linked to the output terminals for this purpose. The configuration data can now be edited using the SIPROM T software tool. The configuration data are then permanently stored in the non-volatile memory (EEPROM).

Once the sensors and power supply have been correctly connected, the transmitter outputs a temperature-linear output signal and the diagnostics LED displays a green light. In the case of a sensor short-circuit, the LED flashes red, an internal device fault is indicated by a steady red light.

The test socket can be used to connect an ammeter at any time for monitoring purposes and plausibility checks. The output current can be read without any interruption, or even without opening the current loop.

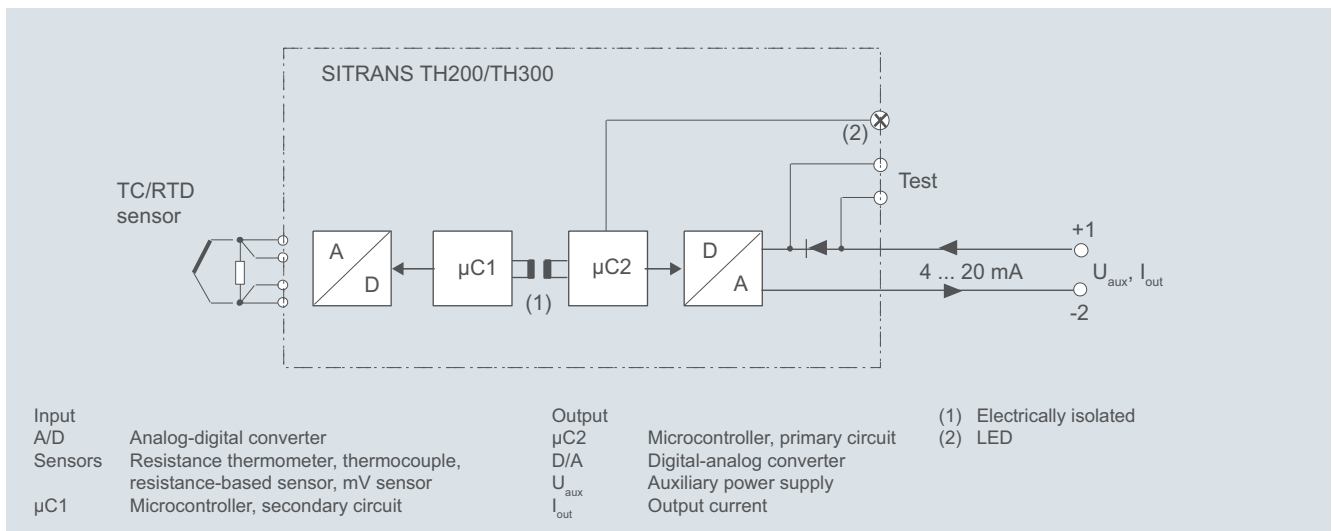

SITRANS TH200 function diagram

Technical specifications

Input			
Resistance thermometer			
Measured variable	Temperature	Response time	≤ 250 ms for 1 sensor with open-circuit monitoring
Sensor type		Open-circuit monitoring	Always active (cannot be disabled)
• to IEC 60751	Pt25 ... Pt1000	Short-circuit monitoring	can be switched on/off (default value: OFF)
• To JIS C 1604; $a = 0.00392 \text{ K}^{-1}$	Pt25 ... Pt1000	Measuring range	parameterizable max. 0 ... 2200 Ω (see table "Digital measuring errors")
• to IEC 60751	Ni25 ... Ni1000	Min. measured span	5 Ω ... 25 Ω (see Table "Digital measuring errors")
• Special type	over special characteristic (max. 30 points)	Characteristic curve	Resistance-linear or special characteristic
Sensor factor	0.25 ... 10 (adaptation of the basic type, e.g. Pt100 to version Pt25 ... 1000)	Thermocouples	
Units	°C or °F	Measured variable	Temperature
Connection		Sensor type (thermocouples)	
• Standard connection	1 resistance thermometer (RTD) in 2-wire, 3-wire or 4-wire system	• Type B	Pt30Rh-Pt6Rh to DIN IEC 584
• Generation of average value	2 identical resistance thermometers in 2-wire system for generation of average temperature	• Type C	W5 %-Re acc. to ASTM 988
• Generation of difference	2 identical resistance thermometers (RTD) in 2-wire system (RTD 1 – RTD 2 or RTD 2 – RTD 1)	• Type D	W3 %-Re acc. to ASTM 988
Interface		• Type E	NiCr-CuNi to DIN IEC 584
• Two-wire system	Parameterizable line resistance ≤ 100 Ω (loop resistance)	• Type J	Fe-CuNi to DIN IEC 584
• Three-wire system	No balancing required	• Type K	NiCr-Ni to DIN IEC 584
• Four-wire system	No balancing required	• Type L	Fe-CuNi to DIN 43710
Sensor current	≤ 0.45 mA	• Type N	NiCrSi-NiSi to DIN IEC 584
Response time	≤ 250 ms for 1 sensor with open-circuit monitoring	• Type R	Pt13Rh-Pt to DIN IEC 584
Open-circuit monitoring	Always active (cannot be disabled)	• Type S	Pt10Rh-Pt to DIN IEC 584
Short-circuit monitoring	can be switched on/off (default value: ON)	• Type T	Cu-CuNi to DIN IEC 584
Measuring range	parameterizable (see table "Digital measuring errors")	• Type U	Cu-CuNi to DIN 43710
Min. measured span	10 °C (18 °F)	Units	°C or °F
Characteristic curve	Temperature-linear or special characteristic	Connection	
Resistance-based sensors		• Standard connection	1 thermocouple (TC)
Measured variable	Actual resistance	• Generation of average value	2 thermocouples (TC)
Sensor type	Resistance-based, potentiometers	• Generation of difference	2 thermocouples (TC) (TC1 – TC2 or TC2 – TC1)
Units	Ω	Response time	≤ 250 ms for 1 sensor with open-circuit monitoring
Connection		Open-circuit monitoring	Can be switched off
• Normal connection	1 resistance-based sensor (R) in 2-wire, 3-wire or 4-wire system	Cold junction compensation	
• Generation of average value	2 resistance-based sensors in 2-wire system for generation of average value	• Internal	With integrated Pt100 resistance thermometer
• Generation of difference	2 resistance thermometers in 2-wire system (R1 – R2 or R2 – R1)	• External	With external Pt100 IEC 60751 (2-wire or 3-wire connection)
Interface		• External fixed	Cold junction temperature can be set as fixed value
• Two-wire system	Parameterizable line resistance ≤ 100 Ω (loop resistance)	Measuring range	Parameterizable (see table "Digital measuring errors")
• Three-wire system	No balancing required	Min. measured span	Min. 40 ... 100 °C (72 ... 180 °F) (see table "Digital measuring errors")
• Four-wire system	No balancing required	Characteristic curve	Temperature-linear or special characteristic
Sensor current	≤ 0.45 mA	mV sensor	
		Measured variable	DC voltage
		Sensor type	DC voltage source (DC voltage source possible over an externally connected resistor)
		Units	mV
		Response time	≤ 250 ms for 1 sensor with open-circuit monitoring
		Open-circuit monitoring	Can be switched off
		Measuring range	-10 ... +70 mV-100 ... +1100 mV

Temperature Measurement

Transmitters for mounting in sensor head

SITRANS TH200 (Universal)

Min. measured span	2 mV or 20 mV
Overload capability of the input	-1.5 ... +3.5 V DC
Input resistance	≥ 1 MΩ
Characteristic curve	Voltage-linear or special characteristic
Output	
Output signal	4 ... 20 mA, 2-wire
Auxiliary power	11 ... 35 V DC ((to 30 V for Ex ia and ib; to 32 V for Ex nA / nL / ic)
Max. load	(U _{aux} - 11 V)/0.023 A
Overrange	3.6 ... 23 mA, infinitely adjustable (default range: 3.80 mA ... 20.5 mA)
Error signal (e.g. following sensor fault) (conforming to NE43)	3.6 ... 23 mA, infinitely adjustable (default value: 22.8 mA)
Sample cycle	0.25 s nominal
Damping	Software filter 1st order 0 ... 30 s (parameterizable)
Protection	Against reversed polarity
Electrically isolated	Input against output (1 kV _{eff})
Measuring accuracy	
Digital measuring errors	See table "Digital measuring errors"
Reference conditions	
• Auxiliary power	24 V ± 1 %
• Load	500 Ω
• Ambient temperature	23 °C
• Warming-up time	> 5 min
Error in the analog output (digital/analog converter)	< 0.025 % of span
Error due to internal cold junction	< 0.5 °C (0.9 °F)
Influence of ambient temperature	
• Analog measuring error	0.02 % of span/10°C (18 °F)
• Digital measuring errors	
- with resistance thermometers	0.06 °C (0.11 °F)/10°C (18 °F)
- with thermocouples	0.6 °C (1.1 °F)/10°C (18 °F)
Auxiliary power effect	< 0.001 % of span/V
Effect of load impedance	< 0.002 % of span/100 Ω
Long-term drift	
• In the first month	< 0.02 % of span
• After one year	< 0.2 % of span
• After 5 years	< 0.3 % of span
Conditions of use	
<u>Ambient conditions</u>	
Ambient temperature range	-40 ... +85 °C (-40 ... +185 °F)
Storage temperature range	-40 ... +85 °C (-40 ... +185 °F)
Relative humidity	< 98 %, with condensation
Electromagnetic compatibility	acc. to EN 61326 and NE21
Construction	
Material	Molded plastic
Weight	50 g (0.11 lb)
Dimensions	See "Dimensional drawings"
Cross-section of cables	Max. 2.5 mm ² (AWG 13)
Degree of protection to IEC 60529	
• Enclosure	IP40
• Terminals	IP00

Certificates and approvals

Explosion protection ATEX

EC type test certificate

• "Intrinsic safety" type of protection

• "Operating equipment that is non-ignitable and has limited energy" type of protection

Explosion protection: FM for USA

• FM approval

• Degree of protection

Explosion protection to FM for Canada (cFM_{US})

• FM approval

• Degree of protection

Other certificates

Software requirements for SIPROM T

PC operating system

Factory setting:

- Pt100 (IEC 751) with 3-wire circuit
- Measuring range: 0 ... 100 °C (32 ... 212 °F)
- Fault current: 22.8 mA
- Sensor offset: 0 °C (0 °F)
- Damping 0.0 s

PTB 05 ATEX 2040X

II 1 G Ex ia IIC T6/T4
II 2 (1) G Ex ia/ib IIC T6/T4
II 3(1) G Ex ia/ic IIC T6/T4
II 1D Ex iaD 20 T115 °C

II 3 G Ex nL IIC T6/T4
II 3 G Ex nA IIC T6/T4

FM 3024169

IS / CI I, II, III / Div 1 / GP ABC-DEFG T6, T5, T4
CI I / ZN 0 / AEx ia IIC T6, T5, T4
NI / CI I / Div 2 / GP ABCDFG T6, T5, T4
NI / CI I / ZN 2 / IIC T6, T5, T4

FM 3024169C

IS / CI I, II, III / Div 1 / GP ABCDEFG T6, T5, T4
NI / CI I / DIV 2 / GP ABCD T6, T5, T4
NIFW / CI I, II, III / DIV 2 / GP ABCDFG T6, T5, T4
DIP / CI II, III / Div 2 / GP FG T6, T5, T4
CI I / ZN 0 / Ex ia IIC T6, T5, T4
CI I / ZN 2 / Ex nA nL IIC T6, T5, T4

EAC Ex(GOST), NEPSI, IEC, EXPOLABS

Windows ME, 2000, XP, Win 7 and Win 8; can also be used in connection with RS 232 modem under Windows 95, 98 and 98SE

Temperature Measurement

Transmitters for mounting in sensor head

SITRANS TH200 (Universal)

Digital measuring errors

Resistance thermometer

Input	Measuring range °C / (°F)	Min. mea- sured span		Digital accuracy	
		°C	(°F)	°C	(°F)
to IEC 60751					
Pt25	-200 ... +850 (-328 ... +1562)	10	(18)	0.3	(0.54)
Pt50	-200 ... +850 (-328 ... +1562)	10	(18)	0.15	(0.27)
Pt100 ... Pt200	-200 ... +850 (-328 ... +1562)	10	(18)	0.1	(0.18)
Pt500	-200 ... +850 (-328 ... +1562)	10	(18)	0.15	(0.27)
Pt1000	-200 ... +350 (-328 ... +662)	10	(18)	0.15	(0.27)
to JIS C1604-81					
Pt25	-200 ... +649 (-328 ... +1200)	10	(18)	0.3	(0.54)
Pt50	-200 ... +649 (-328 ... +1200)	10	(18)	0.15	(0.27)
Pt100 ... Pt200	-200 ... +649 (-328 ... +1200)	10	(18)	0.1	(0.18)
Pt500	-200 ... +649 (-328 ... +1200)	10	(18)	0.15	(0.27)
Pt1000	-200 ... +350 (-328 ... +662)	10	(18)	0.15	(0.27)
Ni 25 ... Ni1000	-60 ... +250 (-76 ... +482)	10	(18)	0.1	(0.18)

Resistance-based sensors

Input	Measuring range Ω	Min. mea- sured span Ω	Digital accuracy Ω
Resistance	0 ... 2200	25	0.25

Thermocouples

Input	Measuring range °C/(°F)	Min. mea- sured span		Digital accu- racy (°F)
		°C	(°F)	
Type B	100 ... 1820 (212 ... 3308)	100	(180)	2 ¹⁾ (3.6) ¹⁾
Type C (W5)	0 ... 2300 (32 ... 4172)	100	(180)	2 (3.6)
Type D (W3)	0 ... 2300 (32 ... 4172)	100	(180)	1 ²⁾ (1.8) ²⁾
Type E	-200 ... +1000 (-328 ... +1832)	50	(90)	1 (1.8)
Type J	-210 ... +1200 (-346 ... +2192)	50	(90)	1 (1.8)
Type K	-230 ... +1370 (-382 ... +2498)	50	(90)	1 (1.8)
Type L	-200 ... +900 (-328 ... +1652)	50	(90)	1 (1.8)
Type N	-200 ... +1300 (-328 ... +2372)	50	(90)	1 (1.8)
Type R	-50 ... +1760 (-58 ... +3200)	100	(180)	2 (3.6)
Type S	-50 ... +1760 (-58 ... +3200)	100	(180)	2 (3.6)
Type T	-200 ... +400 (-328 ... +752)	40	(72)	1 (1.8)
Type U	-200 ... +600 (-328 ... +1112)	50	(90)	2 (3.6)

¹⁾ The digital accuracy in the range 100 to 300 °C (212 to 572 °F) is 3 °C (5.4 °F).

²⁾ The digital accuracy in the range 1750 to 2300 °C (3182 to 4172 °F) is 2 °C (3.6 °F).

mV sensor

Input	Measuring range mV	Min. measured span mV	Digital accuracy μV
mV sensor	-100 ... +1100	20	400

The digital accuracy is the accuracy after the analog/digital conversion including linearization and calculation of the measured value.

An additional error is generated in the output current 4 to 20 mA as a result of the digital/analog conversion of 0.025 % of the set span (digital-analog error).

The total error under reference conditions at the analog output is the sum from the digital error and the digital-analog error (poss. with the addition of cold junction errors in the case of thermocouple measurements).

Temperature Measurement

Transmitters for mounting in sensor head

SITRANS TH200 (Universal)

Selection and Ordering data	Article No.
Temperature transmitter SITRANS TH200 for installation in connection head, type B (DIN 43729), two-wire system, 4 ... 20 mA, programmable, with electrical isolation	
<ul style="list-style-type: none"> • Without explosion protection ▶ ◆ 7NG3211-1NN00 • With explosion protection <ul style="list-style-type: none"> - to ATEX ▶ ◆ 7NG3211-1AN00 - to FM (cFM_{US}) ▶ ◆ 7NG3211-1BN00 	
Further designs	Order code
Add "-Z" to Article No. and specify Order code(s)	
With test protocol (5 measuring points)	C11
Functional safety SIL2	C20
Functional safety SIL2/3	C23
Customer-specific programming	
Add "-Z" to Article No. and specify Order code(s)	
Measuring range to be set Specify in plain text (max. 5 digits): Y01: ... to ... °C, °F	Y01¹⁾
Measuring point no. (TAG), max. 8 characters	Y17²⁾
Measuring point descriptor, max. 16 characters	Y23²⁾
Measuring point message, max. 32 characters	Y24²⁾
Pt100 (IEC) 2-wire, R _L = 0 Ω	U02³⁾
Pt100 (IEC) 3-wire	U03³⁾
Pt100 (IEC) 4-wire	U04³⁾
Thermocouple type B	U20³⁾⁴⁾
Thermocouple type C (W5)	U21³⁾⁴⁾
Thermocouple type D (W3)	U22³⁾⁴⁾
Thermocouple type E	U23³⁾⁴⁾
Thermocouple type J	U24³⁾⁴⁾
Thermocouple type K	U25³⁾⁴⁾
Thermocouple type L	U26³⁾⁴⁾
Thermocouple type N	U27³⁾⁴⁾
Thermocouple type R	U28³⁾⁴⁾
Thermocouple type S	U29³⁾⁴⁾
Thermocouple type T	U30³⁾⁴⁾
Thermocouple type U	U31³⁾⁴⁾
With TC: CJC external (Pt100, 3-wire)	U41
With TC: CJC external with fixed value, specify in plain text	Y50
Special differing customer-specific programming, specify in plain text	Y09⁵⁾
Fail-safe value 3.6 mA (instead of 22,8 mA)	U36²⁾
Cable extension Transmitter with installed cable extension 200 mm (7.81 inch), for Pt100 in four-wire system	W01

Accessories

Further accessories for assembly, connection and transmitter configuration, see page 2/188.

Modem for SITRANS TH100, TH200, TR200 and TF with TH200 incl. SIPROM T parameterization software ▶ **7NG3092-8KU**

With USB connection

DIN rail adapters for head transmitters ▶ **7NG3092-8KA**
(Quantity delivered: 5 units)

Connecting cable **7NG3092-8KC**

4-wire, 150 mm, for sensor connections when using head transmitters in the high hinged cover (set with 5 units)

▶ Available ex stock.

◆ We can offer shorter delivery times for configurations designated with the Quick Ship Symbol ◆. For details see page 10/11 in the appendix.

- 1) For customer-specific programming for RTD and TC, the start value and the end value of the required measuring span must be specified here.
- 2) For this selection, Y01 or Y09 must also be selected.
- 3) For this selection, Y01 must also be selected.
- 4) Internal cold junction compensation is selected as the default for TC.
- 5) For customer-specific programming, for example mV and ohm, the start value and the end value of the required measuring span and the unit must be entered here.

Supply units see Chapter "Supplementary Components".

Ordering example 1:

7NG3211-1NN00-Z Y01+Y17+U03

Y01: -10 ... +100 °C

Y17: TICA123

Ordering example 2:

7NG3211-1NN00-Z Y01+Y23+U25

Y01: -10 ... +100 °C

Y23: TICA1234HEAT


Factory setting:

- Pt100 (IEC 751) with 3-wire circuit
- Measuring range: 0 ... 100 °C (32 ... 212 °F)
- Fault current: 22,8 mA
- Sensor offset: 0 °C (0 °F)
- Damping 0.0 s

Temperature Measurement Transmitters for mounting in sensor head

SITRANS TH200 (Universal)


Dimensional drawings

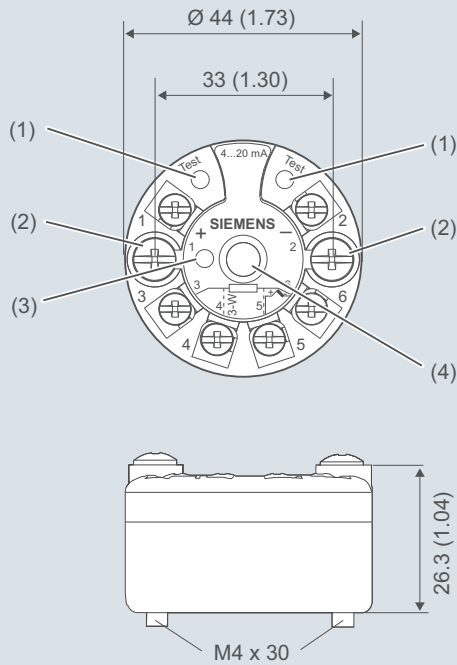


- | | | |
|-----------|----------|--|
| 1(+) | and 2(-) | Auxiliary power supply U_{aux} , output current I_{out} |
| 3, 4, 5 | and 6 | Pt100 sensor (for connections, see Sensor connection assignment) |
| Test (+), | Test (-) | Measurement of the output current with a multimeter |
| (1) | | Test terminal |
| (2) | | Mounting screw M4x30 |
| (3) | | LED for operation indication |
| (4) | | Internal diameter of center hole 6.3 (0.25) |

SITRANS TH200, dimensions and pin assignment, dimensions in mm (inch)

Mounting on DIN rail

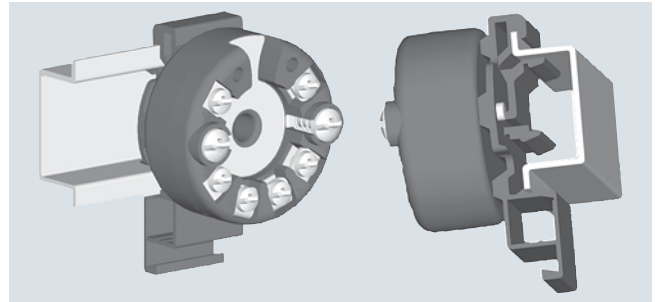

SITRANS TH200, mounting of transmitter on DIN rail

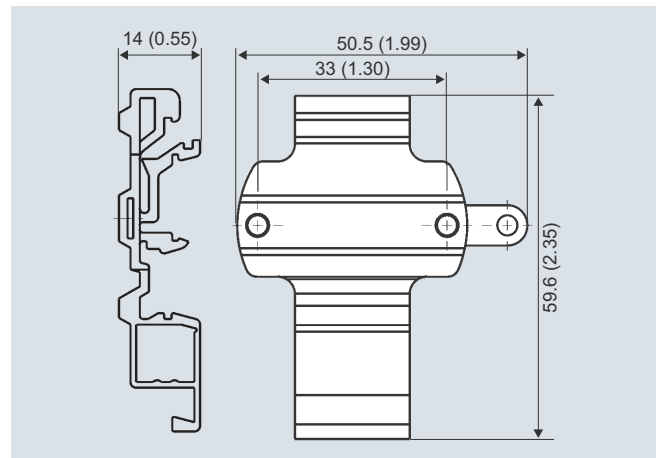

DIN rail adapter, dimensions in mm (inch)

Temperature Measurement


Transmitters for mounting in sensor head

SITRANS TH200 (Universal)


Schematics

2


Resistance thermometer




Two-wire system ¹⁾



Three-wire system




Four-wire system




Generation of average value / difference ¹⁾

¹⁾ Programmable line resistance for the purpose of correction.


Resistance




Two-wire system ¹⁾



Three-wire system




Four-wire system




Generation of average value / difference ¹⁾


Thermocouple




Cold junction compensation
Internal/fixed value



Cold junction compensation with
external Pt100 in two-wire system ¹⁾




Cold junction compensation with
external Pt100 in three-wire system




Generation of average value / difference
with internal cold junction compensation


Voltage measurement



Current measurement



Connection of auxiliary power supply (U_{aux})



SITRANS TH200, sensor connection assignment

Temperature Measurement

Transmitters for mounting in sensor head

SITRANS TH300 (Universal, HART)

Overview



"HART" to beat - the universal SITRANS TH300 transmitter

- Two-wire devices for 4 to 20 mA, HART
- Mounting in the connection head of the temperature sensor
- Universal input for virtually any type of temperature sensor
- Configurable over HART

Benefits

- Compact design
- Flexible mounting and center hole allow you to select your preferred type of installation
- Electrically isolated
- Test sockets for multimeters
- Diagnostics LED (green/red)
- Sensor monitoring open circuits and short-circuits
- Self-monitoring
- Configuration status stored in EEPROM
- SIL2 (with Order code C20), SIL2/3 (with C23)
- Expanded diagnostic functions, such as slave pointer, operating hours counter, etc.
- Special characteristic
- Electromagnetic compatibility to EN 61326 and NE21

Application

SITRANS TH300 transmitters can be used in all industrial sectors. Due to their compact size they can be installed in the connection head type B (DIN 43729) or larger. The following sensors/signal sources can be connected over their universal input module:

- Resistance thermometers (2, 3 or 4-wire system)
- Thermocouples
- Resistance-based sensors and DC voltage sources

The output signal is a direct current from 4 to 20 mA in accordance with the sensor characteristic, superimposed by the digital HART signal.


Transmitters of the "intrinsically safe" type of protection can be installed within potentially explosive atmospheres. The devices comply with the Directive 2014/34/EU (ATEX), as well as FM and CSA regulations.

Function

The SITRANS TH300 is configured over HART. This can be done using a handheld communicator or even more conveniently with a HART modem and the SIMATIC PDM parameterization software. The configuration data are then permanently stored in the non-volatile memory (EEPROM).

Once the sensors and power supply have been correctly connected, the transmitter outputs a temperature-linear output signal and the diagnostics LED displays a green light. In the case of a sensor short-circuit, the LED flashes red, an internal device fault is indicated by a steady red light.

The test socket can be used to connect an ammeter at any time for monitoring purposes and plausibility checks. The output current can be read without any interruption, or even without opening the current loop.

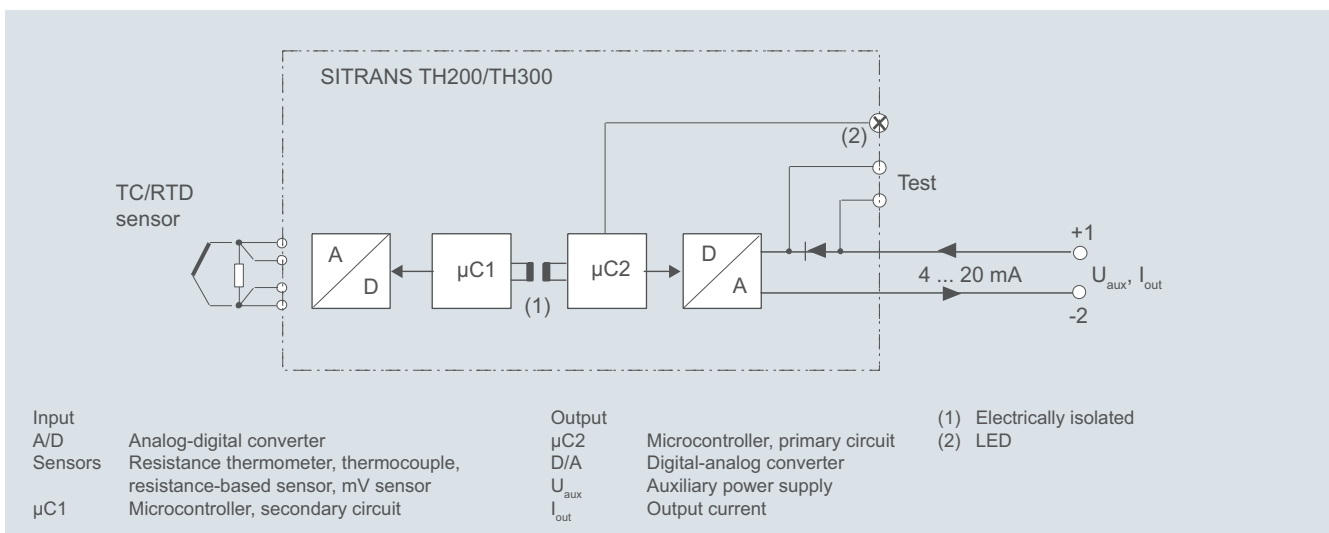

SITRANS TH 300 function diagram

Temperature Measurement

Transmitters for mounting in sensor head

SITRANS TH300 (Universal, HART)

Technical specifications

Input		Response time	≤ 250 ms for 1 sensor with open-circuit monitoring
<u>Resistance thermometer</u>		Open-circuit monitoring	Always active (cannot be disabled)
Measured variable	Temperature	Short-circuit monitoring	can be switched on/off (default value: OFF)
Sensor type		Measuring range	parameterizable max. 0 ... 2200 Ω (see table "Digital measuring errors")
<ul style="list-style-type: none"> to IEC 60751 To JIS C 1604; $\alpha = 0.00392 \text{ K}^{-1}$ to IEC 60751 Special type 	Pt25 ... Pt1000 Pt25 ... Pt1000 Ni25 ... Ni1000	Min. measured span	5 ... 25 Ω (see table "Digital measuring errors")
Sensor factor	0.25 ... 10 (adaptation of the basic type, e.g. Pt100 to version Pt25 ... 1000)	Characteristic curve	Resistance-linear or special characteristic
Units	°C or °F	<u>Thermocouples</u>	
Connection		Measured variable	Temperature
<ul style="list-style-type: none"> Standard connection Generation of average value Generation of difference 	1 resistance thermometer (RTD) in 2-wire, 3-wire or 4-wire system 2 identical resistance thermometers in 2-wire system for generation of average temperature 2 identical resistance thermometers (RTD) in 2-wire system (RTD 1 – RTD 2 or RTD 2 – RTD 1)	Sensor type (thermocouples)	
Interface		<ul style="list-style-type: none"> Type B Type C Type D Type E Type J Type K Type L Type N Type R Type S Type T Type U 	Pt30Rh-Pt6Rh to DIN IEC 584 W5 %-Re acc. to ASTM 988 W3 %-Re acc. to ASTM 988 NiCr-CuNi to DIN IEC 584 Fe-CuNi to DIN IEC 584 NiCr-Ni to DIN IEC 584 Fe-CuNi to DIN 43710 NiCrSi-NiSi to DIN IEC 584 Pt13Rh-Pt to DIN IEC 584 Pt10Rh-Pt to DIN IEC 584 Cu-CuNi to DIN IEC 584 Cu-CuNi to DIN 43710
<ul style="list-style-type: none"> Two-wire system Three-wire system Four-wire system 	Parameterizable line resistance ≤ 100 Ω (loop resistance) No balancing required No balancing required	Units	°C or °F
Sensor current	≤ 0.45 mA	Connection	<ul style="list-style-type: none"> Standard connection Generation of average value Generation of difference
Response time	≤ 250 ms for 1 sensor with open-circuit monitoring	<ul style="list-style-type: none"> Standard connection Generation of average value Generation of difference 	1 thermocouple (TC) 2 thermocouples (TC) 2 thermocouples (TC) (TC1 – TC2 or TC2 – TC1)
Open-circuit monitoring	Always active (cannot be disabled)	Response time	≤ 250 ms for 1 sensor with open-circuit monitoring
Short-circuit monitoring	can be switched on/off (default value: ON)	Open-circuit monitoring	can be switched off
Measuring range	parameterizable (see table "Digital measuring errors")	Cold junction compensation	<ul style="list-style-type: none"> Internal External External fixed
Min. measured span	10 °C (18 °F)	<ul style="list-style-type: none"> Internal External External fixed 	With integrated Pt100 resistance thermometer With external Pt100 IEC 60751 (2-wire or 3-wire connection) Cold junction temperature can be set as fixed value
Characteristic curve	Temperature-linear or special characteristic	Measuring range	parameterizable (see table "Digital measuring errors")
<u>Resistance-based sensors</u>		Min. measured span	Min. 40 ... 100 °C (72 ... 180 °F) (see table "Digital measuring errors")
Measured variable	Actual resistance	Characteristic curve	Temperature-linear or special characteristic
Sensor type	Resistance-based, potentiometers	<u>mV sensor</u>	
Units	Ω	Measured variable	DC voltage
Connection		Sensor type	DC voltage source (DC voltage source possible over an externally connected resistor)
<ul style="list-style-type: none"> Normal connection Generation of average value Generation of difference 	1 resistance-based sensor (R) in 2-wire, 3-wire or 4-wire system 2 resistance-based sensors in 2-wire system for generation of average value 2 resistance thermometers in 2-wire system (R1 – R2 or R2 – R1)	Units	mV
Interface		Response time	≤ 250 ms for 1 sensor with open-circuit monitoring
<ul style="list-style-type: none"> Two-wire system Three-wire system Four-wire system 	Parameterizable line resistance ≤ 100 Ω (loop resistance) No balancing required No balancing required	Open-circuit monitoring	Can be switched off
Sensor current	≤ 0.45 mA		

Temperature Measurement

Transmitters for mounting in sensor head

SITRANS TH300 (Universal, HART)

Measuring range	-10 ... +70 mV -100 ... +1100 mV	Construction	Material Molded plastic
Min. measured span	2 mV or 20 mV		
Overload capability of the input	-1.5 ... +3.5 V DC	Weight 50 g (0.11 lb)	Dimensions See "Dimensional drawings"
Input resistance	≥ 1 MΩ		
Characteristic curve	Voltage-linear or special characteristic	Cross-section of cables Max. 2.5 mm ² (AWG 13)	Degree of protection to IEC 60529 • Enclosure IP40 • Terminals IP00
Output			
Output signal	4 ... 20 mA, 2-wire with communication acc. to HART Rev. 5.9	Certificates and approvals	
Auxiliary power	11 ... 35 V DC (to 30 V for Ex ia and ib; to 32 V for Ex nA/nL/ic)	Explosion protection ATEX	
Max. load	(U _{aux} - 11 V)/0.023 A	EC type test certificate PTB 05 ATEX 2040X	
Overrange	3.6 ... 23 mA, infinitely adjustable (default range: 3.80 mA ... 20.5 mA)	• "Intrinsic safety" type of protection II 1 G Ex ia IIC T6/T4 II 2 (1) G Ex ia/ib IIC T6/T4 II 3(1) G Ex ia/ic IIC T6/T4 II 1D Ex iaD 20 T115 °C	
Error signal (e.g. following sensor fault) (conforming to NE43)	3.6 ... 23 mA, infinitely adjustable (default value: 22.8 mA)	• "Operating equipment that is non-ignitable and has limited energy" type of protection II 3 G Ex nL IIC T6/T4 II 3 G Ex nA IIC T6/T4	
Sample cycle	0.25 s nominal	Explosion protection: FM for USA	
Damping	Software filter 1st order 0 ... 30 s (parameterizable)	• FM approval FM 3024169	
Protection	Against reversed polarity	• Degree of protection IS / CI I, II, III / Div 1 / GP ABC-DEFG T6, T5, T4 CI I / ZN 0 / AEx ia IIC T6, T5, T4 NI / CI I / Div 2 / GP ABCDFG T6, T5, T4 NI / CI I / ZN 2 / IIC T6, T5, T4	
Electrically isolated	Input against output (1 kV _{eff})	Explosion protection to FM for Canada (cFM _{US}) • FM approval FM 3024169C • Degree of protection IS / CI I, II, III / Div 1 / GP ABC-DEFG T6, T5, T4 NI / CI I / Div 2 / GP ABCD T6, T5, T4 NIFW / CI I, II, III / Div 2 / GP ABCDFG T6, T5, T4 DIP / CI II, III / Div 2 / GP FG T6, T5, T4 CI I / ZN 0 / Ex ia IIC T6, T5, T4 CI I / ZN 2 / Ex nA nL IIC T6, T5, T4	
Measuring accuracy		Other certificates EAC Ex(GOST), NEPSI, IEC, EXPOLABS	
Digital measuring errors	See Table "Digital measuring errors"	Factory setting:	
Reference conditions		• Pt100 (IEC 751) with 3-wire circuit	
• Auxiliary power	24 V ± 1 %	• Measuring range: 0 ... 100 °C (32 ... 212 °F)	
• Load	500 Ω	• Fault current: 22.8 mA	
• Ambient temperature	23 °C	• Sensor offset: 0 °C (0 °F)	
• Warming-up time	> 5 min	• Damping 0.0 s	
Error in the analog output (digital/analog converter)	< 0.025 % of span		
Error due to internal cold junction	< 0.5 °C (0.9 °F)		
Influence of ambient temperature			
• Analog measuring error	0.02 % of span/10°C (18 °F)		
• Digital measuring errors			
- with resistance thermometers	0.06 °C (0.11 °F)/10°C (18 °F)		
- with thermocouples	0.6 °C (1.1 °F)/10°C (18 °F)		
Auxiliary power effect	< 0.001 % of span/V		
Effect of load impedance	< 0.002 % of span/100 Ω		
Long-term drift			
• In the first month	< 0.02 % of span		
• After one year	< 0.2 % of span		
• After 5 years	< 0.3 % of span		
Conditions of use			
<u>Ambient conditions</u>			
Ambient temperature range	-40 ... +85 °C (-40 ... +185 °F)		
Storage temperature range	-40 ... +85 °C (-40 ... +185 °F)		
Relative humidity	< 98 %, with condensation		
Electromagnetic compatibility	acc. to EN 61326 and NE21		

Temperature Measurement

Transmitters for mounting in sensor head

SITRANS TH300 (Universal, HART)

Digital measuring errors

Resistance thermometer

Input	Measuring range °C/(°F)	Min. mea- sured span		Digital accuracy	
		°C	(°F)	°C	(°F)
to IEC 60751					
Pt25	-200 ... +850 (-328 ... +1562)	10	(18)	0.3	(0.54)
Pt50	-200 ... +850 (-328 ... +1562)	10	(18)	0.15	(0.27)
Pt100 ... Pt200	-200 ... +850 (-328 ... +1562)	10	(18)	0.1	(0.18)
Pt500	-200 ... +850 (-328 ... +1562)	10	(18)	0.15	(0.27)
Pt1000	-200 ... +350 (-328 ... +662)	10	(18)	0.15	(0.27)
to JIS C1604-81					
Pt25	-200 ... +649 (-328 ... +1200)	10	(18)	0.3	(0.54)
Pt50	-200 ... +649 (-328 ... +1200)	10	(18)	0.15	(0.27)
Pt100 ... Pt200	-200 ... +649 (-328 ... +1200)	10	(18)	0.1	(0.18)
Pt500	-200 ... +649 (-328 ... +1200)	10	(18)	0.15	(0.27)
Pt1000	-200 ... +350 (-328 ... +662)	10	(18)	0.15	(0.27)
Ni 25 ... Ni1000	-60 ... +250 (-76 ... +482)	10	(18)	0.1	(0.18)

Resistance-based sensors

Input	Measuring range Ω	Min. mea- sured span Ω	Digital accuracy Ω
Resistance	0 ... 2200	25	0.25

Thermocouples

Input	Measuring range °C/(°F)	Min. mea- sured span		Digital accuracy	
		°C	(°F)	°C	(°F)
Type B	100 ... 1820 (212 ... 3308)	100	(180)	2 ¹⁾	(3.6) ¹⁾
Type C (W5)	0 ... 2300 (32 ... 4172)	100	(180)	2	(3.6)
Type D (W3)	0 ... 2300 (32 ... 4172)	100	(180)	1 ²⁾	(1.8) ²⁾
Type E	-200 ... +1000 (-328 ... +1832)	50	(90)	1	(1.8)
Type J	-210 ... +1200 (-346 ... +2192)	50	(90)	1	(1.8)
Type K	-230 ... +1370 (-382 ... +2498)	50	(90)	1	(1.8)
Type L	-200 ... +900 (-328 ... +1652)	50	(90)	1	(1.8)
Type N	-200 ... +1300 (-328 ... +2372)	50	(90)	1	(1.8)
Type R	-50 ... +1760 (-58 ... +3200)	100	(180)	2	(3.6)
Type S	-50 ... +1760 (-58 ... +3200)	100	(180)	2	(3.6)
Type T	-200 ... +400 (-328 ... +752)	40	(72)	1	(1.8)
Type U	-200 ... +600 (-328 ... +1112)	50	(90)	2	(3.6)

¹⁾ The digital accuracy in the range 100 to 300 °C (212 to 572 °F) is 3 °C (5.4 °F).

²⁾ The digital accuracy in the range 1750 to 2300 (3182 to 4172 °F) is 2 °C (3.6 °F).

mV sensor

Input	Measuring range mV	Min. mea- sured span mV	Digital accuracy μV
mV sensor	-100 ... +1100	20	400

The digital accuracy is the accuracy after the analog/digital conversion including linearization and calculation of the measured value.

An additional error is generated in the output current 4 to 20 mA as a result of the digital/analog conversion of 0.025 % of the set span (digital-analog error).

The total error under reference conditions at the analog output is the sum from the digital error and the digital-analog error (poss. with the addition of cold junction errors in the case of thermocouple measurements).

Temperature Measurement

Transmitters for mounting in sensor head

SITRANS TH300 (Universal, HART)

Selection and Ordering data	Article No.
Temperature transmitter SITRANS TH300 for installation in connection head, type B (DIN 43729), two-wire system 4 ... 20 mA, communication capable to HART, with galvanic isolation <ul style="list-style-type: none"> • Without explosion protection ▶ ◆ 7NG3212-0NN00 • With explosion protection <ul style="list-style-type: none"> - to ATEX ▶ ◆ 7NG3212-0AN00 - to FM (C_{FMUS}) ▶ ◆ 7NG3212-0BN00 	
Further designs Add "-Z" to Article No. and specify Order code(s) with test protocol (5 measuring points)	Order code C11 C20 C23
Customer-specific programming Add "-Z" to Article No. and specify Order code(s) Measuring range to be set Specify in plain text (max. 5 digits): Y01: ... to ... °C, °F Measuring point no. (TAG), max. 8 characters Measuring point descriptor, max. 16 characters Measuring point message, max. 32 characters Pt100 (IEC) 2-wire, R _L = 0 Ω Pt100 (IEC) 3-wire Pt100 (IEC) 4-wire Thermocouple type B Thermocouple type C (W5) Thermocouple type D (W3) Thermocouple type E Thermocouple type J Thermocouple type K Thermocouple type L Thermocouple type N Thermocouple type R Thermocouple type S Thermocouple type T Thermocouple type U With TC: CJC external (Pt100, 3-wire) With TC: CJC external with fixed value, specify in plain text Special differing customer-specific programming, specify in plain text Fail-safe value 3.6 mA (instead of 22,8 mA) Cable extension Transmitter with installed cable extension 200 mm (7.87 inch), for Pt100 in four-wire system	Order code Y01¹⁾ Y17²⁾ Y23²⁾ Y24²⁾ U02³⁾ U03³⁾ U04³⁾ U20³⁾⁴⁾ U21³⁾⁴⁾ U22³⁾⁴⁾ U23³⁾⁴⁾ U24³⁾⁴⁾ U25³⁾⁴⁾ U26³⁾⁴⁾ U27³⁾⁴⁾ U28³⁾⁴⁾ U29³⁾⁴⁾ U30³⁾⁴⁾ U31³⁾⁴⁾ U41 Y50 Y09⁵⁾ U36²⁾ W01

Accessories

Further accessories for assembly, connection and transmitter configuration, see page 2/188.

HART modem

- With USB connection ▶

Article No.

7MF4997-1DB

SIMATIC PDM operating software

See Section 8

DIN rail adapters for head transmitters

7NG3092-8KA

(Quantity delivered: 5 units)

Connecting cable

7NG3092-8KC

4-wire, 150 mm, for sensor connections when using head transmitters in the high hinged cover (set with 5 units)

- ▶ Available ex stock.

- ◆ We can offer shorter delivery times for configurations designated with the Quick Ship Symbol ◆. For details see page 10/11 in the appendix.

- 1) For customer-specific programming for RTD and TC, the start value and the end value of the required measuring span must be specified here.
- 2) For this selection, Y01 or Y09 must also be selected.
- 3) For this selection, Y01 must also be selected.
- 4) Internal cold junction compensation is selected as the default for TC.
- 5) For customer-specific programming, for example mV and ohm, the start value and the end value of the required measuring span and the unit must be entered here.

Supply units see Chapter "Supplementary Components".

Ordering example 1:

7NG3212-0NN00-Z Y01+Y17+U03
 Y01: -10 ... +100 °C
 Y17: TICA123

Ordering example 2:

7NG3212-0NN00-Z Y01+Y23+U25
 Y01: -10 ... +100 °C
 Y23: TICA1234HEAT

Factory setting:



- Pt100 (IEC 751) with 3-wire circuit
- Measuring range: 0 ... 100 °C (32 ... 212 °F)
- Fault current: 22.8 mA
- Sensor offset: 0 °C (0 °F)
- Damping 0.0 s

Temperature Measurement

Transmitters for mounting in sensor head

SITRANS TH300 (Universal, HART)


Dimensional drawings

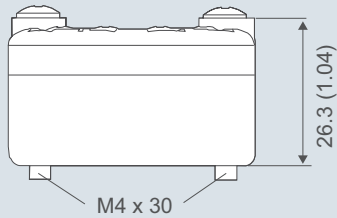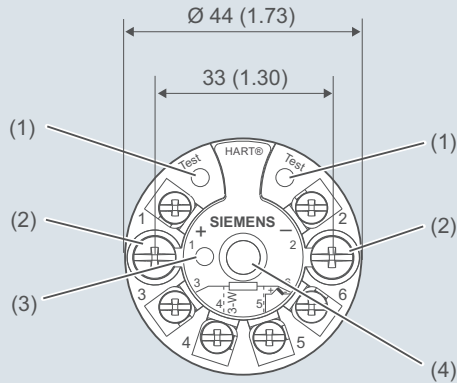


- | | | |
|-----------|----------|--|
| 1(+) | and 2(-) | Auxiliary power supply U_{aux} , output current I_{out} |
| 3, 4, 5 | and 6 | Pt100 sensor (for connections, see Sensor connection assignment) |
| Test (+), | Test (-) | Measurement of the output current with a multimeter |
| (1) | | Test terminal |
| (2) | | Mounting screw M4x30 |
| (3) | | LED for operation indication |
| (4) | | Internal diameter of center hole 6.3 (0.25) |

SITRANS TH300, dimensions and pin assignment, dimensions in mm (inch)

Mounting on DIN rail

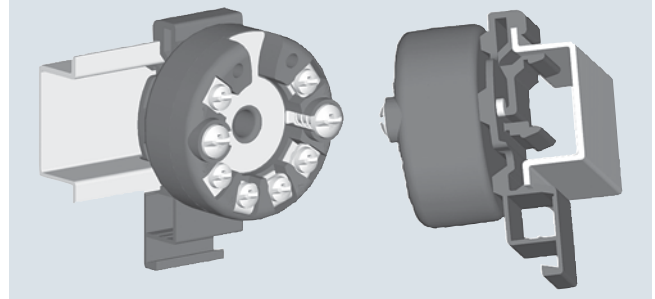

SITRANS TH300, mounting of transmitter on DIN rail

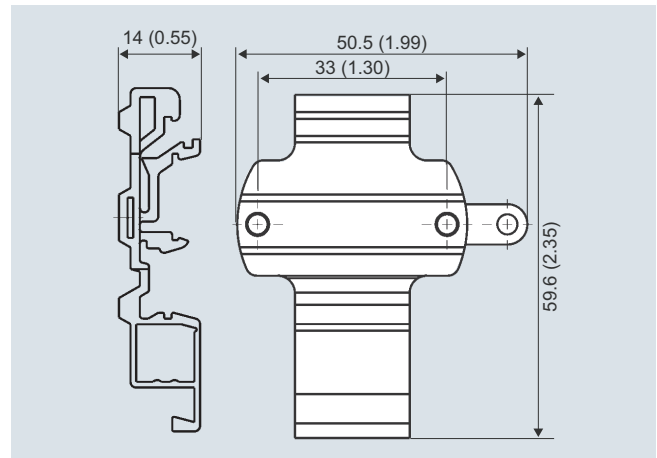


DIN rail adapter, dimensions in mm (inch)


Schematics

2


Resistance thermometer




Two-wire system ¹⁾



Three-wire system




Four-wire system




Generation of average value / difference ¹⁾

¹⁾ Programmable line resistance for the purpose of correction.


Resistance




Two-wire system ¹⁾



Three-wire system




Four-wire system




Generation of average value / difference ¹⁾


Thermocouple




Cold junction compensation
Internal/fixed value



Cold junction compensation with
external Pt100 in two-wire system ¹⁾




Cold junction compensation with
external Pt100 in three-wire system




Generation of average value / difference
with internal cold junction compensation


Voltage measurement



Current measurement



Connection of auxiliary power supply (U_{aux})



SITRANS TH300, sensor connection assignment

Temperature Measurement

Transmitters for mounting in sensor head

SITRANS TH400 fieldbus transmitter

Overview



SITRANS TH400 fieldbus transmitters

Versions:

- For FOUNDATION fieldbus
- For PROFIBUS PA

The SITRANS TH400 temperature transmitter is a small field bus transmitter for mounting in the connection head of form B. Extensive functionality enables the temperature transmitter to be precisely adapted to the plant's requirements. Operation is very simple in spite of the numerous setting options. Thanks to its universal concept it can be used in all industries and is easy to integrate in the context of Totally Integrated Automation applications.

Transmitters of the "intrinsically safe" type of protection can be installed within potentially explosive atmospheres. The devices comply with the Directive 2014/34/EU (ATEX), as well as FM and CSA regulations.

Installing SITRANS TH400 in temperature sensors turns them into complete, bus-capable measuring points; compact - and in a single device.

Application

- Linearized temperature measurement with resistance thermometers or thermal elements
- Differential, mean-value or redundant temperature measurement with resistance thermometers or thermal elements
- Linear resistance and bipolar millivolt measurements
- Differential, mean-value or redundant resistance and bipolar millivolt measurements

Function

Features

- Mounting in connection head, type B, to DIN 43729, or larger
- Polarity-neutral bus connection
- 24-bit analog-digital converter for high resolution
- Electrically isolated
- Intrinsically-safe version for use in potentially explosive areas
- Special characteristic
- Sensor redundancy

With PROFIBUS PA communication

- Function blocks: 2 x analog


With FOUNDATION fieldbus communication

- Function blocks: 2 x analog and 1 x PID
- Functionality: Basic or LAS

Mode of operation

The following function diagram explains the mode of operation of the transmitter.

The only difference between the two versions of the SITRANS TH400 (7NG3214-... and 7NG3215-...) is the type of fieldbus protocol used (PROFIBUS PA or FOUNDATION fieldbus).

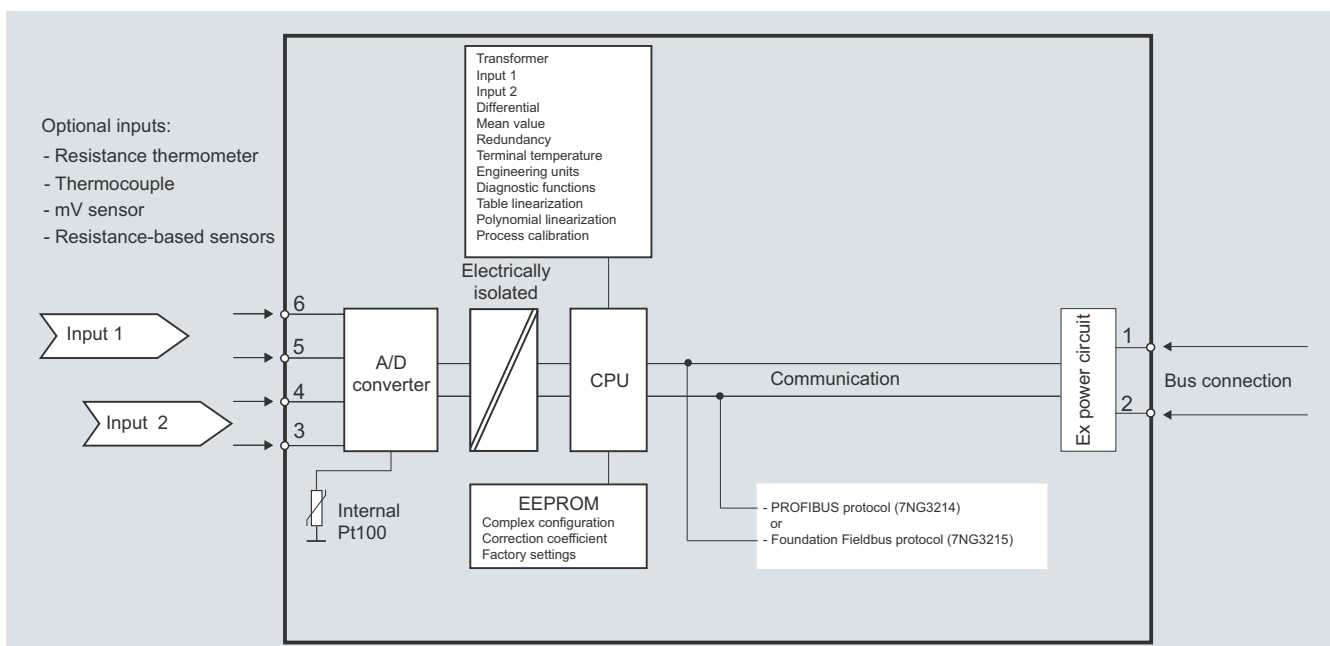


SITRANS TH400, function diagram

Temperature Measurement

Transmitters for mounting in sensor head

SITRANS TH400 fieldbus transmitter

System communication

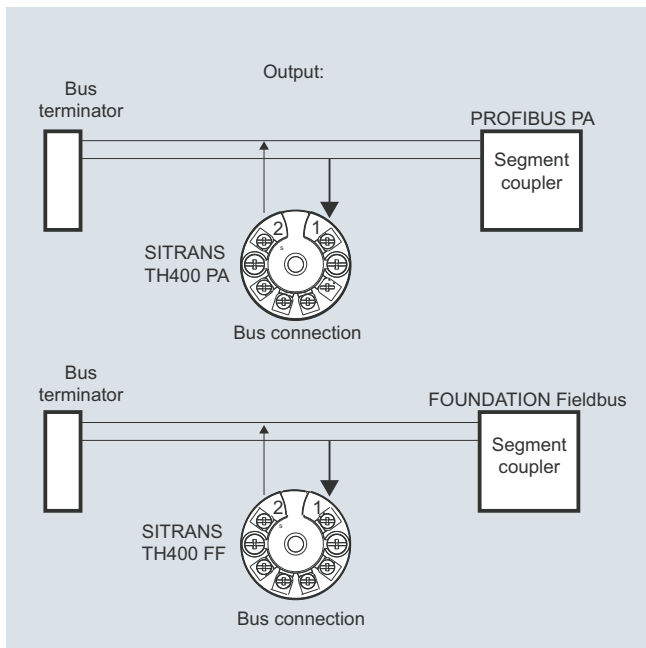

SITRANS TH400, communication interface

Technical specifications

Input

Analog-to-digital conversion

- Measurement rate < 50 ms
- Resolution 24-bit

Resistance thermometer

Pt25 ... Pt1000 to IEC 60751/JIS C 1604

- Measuring range -200 ... +850 °C (-328 ... +1562 °F)

Ni25 ... Ni1000 to DIN 43760

- Measuring range -60 ... +250 °C (-76 ... +482 °F)

Cu10 ... Cu1000, $\alpha = 0.00427$

- Measuring range -50 ... +200 °C (-58 ... +392 °F)

Line resistance per sensor cable Max. 50 Ω

Sensor current Nominal 0.2 mA

Sensor fault detection

- Sensor break detection Yes
- Sensor short-circuit detection Yes, < 15 Ω

Resistance-based sensors

Measuring range 0 Ω ... 10 k Ω Line resistance per sensor cable Max. 50 Ω

Sensor current Nominal 0.2 mA

Sensor fault detection

- Sensor break detection Yes
- Sensor short-circuit detection Yes, < 15 Ω

Thermocouple

to IEC 584

- Type B
- Type E
- Type J
- Type K
- Type N
- Type R
- Type S
- Type T

to DIN 43710

- Type L
- Type U

to ASTM E988-90

- Type W3
- Type W5

External cold junction compensation -40 ... +135 °C (-40 ... +275 °F)

Sensor fault detection

- Sensor break detection Yes
- Sensor short-circuit detection Yes, < 3 mV
- Sensor current in the event of open-circuit monitoring 4 μ A

mV sensor - voltage input

Measuring range -800 ... +800 mV

Input resistance 10 M Ω

Output

Filter time (programmable) 0 ... 60 s

Update time < 400 ms

Measuring accuracy

Accuracy is defined as the higher value of general values and basic values.

General values

Type of input

All

Absolute accuracy

 $\leq \pm 0.05$ % of the measured value

Temperature coefficient

 $\leq \pm 0.002$ % of the measured value/°C

Basic values

Type of input

Pt100 and Pt1000

Ni100

Cu10

Resistance-based sensors

Voltage source

Thermocouple, type: E, J, K, L, N, T, U

Thermocouple, type: B, R, S, W3, W5

Cold junction compensation

Basic accuracy

 $\leq \pm 0.1$ °C $\leq \pm 0.15$ °C $\leq \pm 1.3$ °C $\leq \pm 0.05$ Ω $\leq \pm 10$ μ V $\leq \pm 0.5$ °C $\leq \pm 1$ °C $\leq \pm 0.5$ °C

Temperature coefficient

 $\leq \pm 0.002$ °C/°C $\leq \pm 0.002$ °C/°C $\leq \pm 0.02$ °C/°C $\leq \pm 0.002$ Ω /°C $\leq \pm 0.2$ % μ V/°C $\leq \pm 0.01$ °C/°C $\leq \pm 0.025$ °C/°C

Reference conditions

Warming-up time 30 s

Signal-to-noise ratio Min. 60 dB

Calibration condition 20 ... 28 °C (68 ... 82 °F)

Temperature Measurement

Transmitters for mounting in sensor head

SITRANS TH400 fieldbus transmitter

Conditions of use

Ambient conditions

Permissible ambient temperature	-40 ... +85 °C (-40 ... +185 °F)
Permissible storage temperature	-40 ... +85 °C (-40 ... +185 °F)
Relative humidity	≤ 98 %, with condensation

Insulation resistance

• Test voltage	500 V AC for 60 s
----------------	-------------------

Mechanical testing

• Vibrations (DIN class B) to	IEC 60068-2-6 and IEC 60068-2-64 4 g/2 ... 100 Hz
-------------------------------	---

Electromagnetic compatibility

EMC noise voltage influence	< ± 0.1 % of span
-----------------------------	-------------------

Extended EMC noise immunity: NAMUR NE 21, criterion A, Burst	< ± 1 % of span
---	-----------------

EMC 2014/30/EU Emission and Noise Immunity to	EN 61326
--	----------

Construction

Material	Molded plastic
Weight	55 g (0.12 lb)
Dimensions	See Dimensional drawings
Cross-section of cables	Max. 2.5 mm ² (AWG 13)
Degree of protection	
• Transmitter enclosure	IP40
• Terminal	IP00

Auxiliary power

Power supply	
• Standard, Ex "nA", Ex "nL", NI	9.0 ... 32 V DC
• ATEX, FM, UL and CSA	9.0 ... 30 V DC
• In FISCO/FNICO installations	9.0 ... 17.5 V DC
Power consumption	< 11 mA
Max. increase in power consumption in the event of a fault	< 7 mA

Certificates and approvals

Explosion protection ATEX

EC type test certificate	
• "Intrinsic safety" type of protection	II 1 G Ex ia IIC T4...T6 II 2(1) G Ex ib[ia] IIC T4...T6 II 1 D Ex iaD

EC type test certificate

• Type of protection for "equipment is non-arcing"	KEMA 06 ATEX 0263 X II 3 GD Ex nA[nL] IIC T4...T6 II 3 GD Ex nL IIC T4...T6 II 3 GD Ex nA[ic] IIC T4...T6 II 3 GD Ex ic IIC T4...T6
---	---

Explosion protection: FM for USA

• FM approval	FM 3027985
• Degree of protection	• IS Class I, Div 1, Groups A, B, C, D T4/T5/T6, FISCO • IS Class I, Zone 0, AEx ia, IIC T4/T5/T6, FISCO • NI Class I, Div 2, Groups A, B, C, D T4/T5/T6, FNICO

Explosion protection CSA for Canada

• CSA approval	CSA 1861385
• Degree of protection	• IS Class I, Div 1, Groups A, B, C, D T4/T5/T6 • Ex ia IIC T4/T5/T6 and Ex ib [ia] IIC T4/T5/T6 • NI Class I, Div 2, Groups A, B, C, D T4/T5/T6 • Ex nA II T4/T5/T6

Other certificates

Communication

Parameterization interface

• PROFIBUS PA connection	
- Protocol	Profile 3.0
- Address (for delivery)	126
• FOUNDATION fieldbus connection	
- Protocol	FF protocol
- Functionality	Basic or LAS
- Version	ITK 4.6
- Function blocks	2 x analog and 1 x PID

Factory setting

only for SITRANS TH400 PA

Sensor	Pt100 (IEC)
Type of connection	3-wire circuit
Unit	°C
Failure mode	Last valid value
Filter time	0 s
PA address	126
PROFIBUS Ident No.	Manufacturer-specific

only for SITRANS TH400 FF

Sensor	Pt100 (IEC)
Type of connection	3-wire circuit
Unit	°C
Failure mode	Last valid value
Filter time	0 s
Node address	22

Temperature Measurement

Transmitters for mounting in sensor head

SITRANS TH400 fieldbus transmitter


Selection and Ordering data	Article No.	Accessories	Article No.
Temperature transmitter SITRANS TH400 for installation in connection head, with electrical isolation, order operating instructions separately.		Further accessories for assembly, connection and transmitter configuration, see page 2/188.	
<ul style="list-style-type: none"> • Bus-compatible to PROFIBUS PA <ul style="list-style-type: none"> - No explosion protection or Zone 2/Div 2 to ATEX/FM/CSA/IECEX/NEPSI ▶ ◆ 7NG3214-0NN00 - With explosion protection "Intrinsically safe to ATEX/FM/CSA/IECEX/NEPSI" ▶ ◆ 7NG3214-0AN00 • Bus-compatible to FOUNDATION Fieldbus <ul style="list-style-type: none"> - No explosion protection or Zone 2/Div 2 to ATEX/FM/CSA/IECEX/NEPSI ▶ ◆ 7NG3215-0NN00 - With explosion protection "Intrinsically safe to ATEX/FM/CSA/IECEX/NEPSI" ▶ ◆ 7NG3215-0AN00 		SIMATIC PDM operating software DIN rail adapters for head transmitters (Quantity delivered: 5 units)	See Chapter 8 7NG3092-8KA 7NG3092-8KC
Further designs Please add "-Z" to Article No. and specify Order code(s) and plain text.	Order code	Connecting cable 4-wire, 150 mm, for sensor connections when using head transmitters in the high hinged cover (set with 5 units)	See Catalog IK PI
With test protocol (5 measuring points)	C11	for additional PA components ▶ Available ex stock. ◆ We can offer shorter delivery times for configurations designated with the Quick Ship Symbol ◆. For details see page 10/11 in the appendix.	
Customer-specific programming Add "-Z" to Article No. and specify Order code(s)		1) For customer-specific programming for RTD and TC, the start value and the end value of the required measuring span must be specified here. 2) For this selection, Y01 or Y09 must also be selected. 3) For this selection, Y01 must also be selected. 4) Internal cold junction compensation is selected as the default for TC. 5) For customer-specific programming, for example mV and ohm, the start value and the end value of the required measuring span and the unit must be entered here.	
Measuring range to be set Specify in plain text (max. 5 digits): Y01: ... to ... °C, °F	Y01¹⁾	Ordering example 1: 7NG3214-0NN00-Z Y01+Y17+U03 Y01: 0...100 °C Y17: TICA1234HEAT	
Measuring point no. (TAG), max. 8 characters	Y17²⁾	Ordering example 2: 7NG3214-0NN00-Z Y01+Y17+Y25+U25 Y01: 0...500 °C Y17: TICA5678HEAT Y25: 33	
Measuring point descriptor, max. 16 characters	Y23²⁾	Factory setting:	
Measuring point message, max. 32 characters	Y24²⁾	<ul style="list-style-type: none"> • For SITRANS TH400 PA: <ul style="list-style-type: none"> - Pt100 (IEC 751) with 3-wire circuit - Unit: °C - Failure mode: Last valid value - Filter time: 0 s - PA address: 126 - PROFIBUS Ident No.: Manufacturer-specific • For SITRANS TH400 FF: <ul style="list-style-type: none"> - Pt100 (IEC 751) with 3-wire circuit - Unit: °C - Failure mode: Last valid value - Filter time: 0 s - Node address: 22 	
Bus address, specify in plain text	Y25²⁾		
Pt100 (IEC) 2-wire, R _L = 0 Ω	U02³⁾		
Pt100 (IEC) 3-wire	U03³⁾		
Pt100 (IEC) 4-wire	U04³⁾		
Thermocouple type B	U20³⁾⁴⁾		
Thermocouple type C (W5)	U21³⁾⁴⁾		
Thermocouple type D (W3)	U22³⁾⁴⁾		
Thermocouple type E	U23³⁾⁴⁾		
Thermocouple type J	U24³⁾⁴⁾		
Thermocouple type K	U25³⁾⁴⁾		
Thermocouple type L	U26³⁾⁴⁾		
Thermocouple type N	U27³⁾⁴⁾		
Thermocouple type R	U28³⁾⁴⁾		
Thermocouple type S	U29³⁾⁴⁾		
Thermocouple type T	U30³⁾⁴⁾		
Thermocouple type U	U31³⁾⁴⁾		
With TC: CJC external (Pt100, 3-wire)	U41		
With TC: CJC external with fixed value, specify in plain text	Y50		
Special differing customer-specific programming, specify in plain text	Y09⁵⁾		

Temperature Measurement

Transmitters for mounting in sensor head


SITRANS TH400 fieldbus transmitter

Dimensional drawings

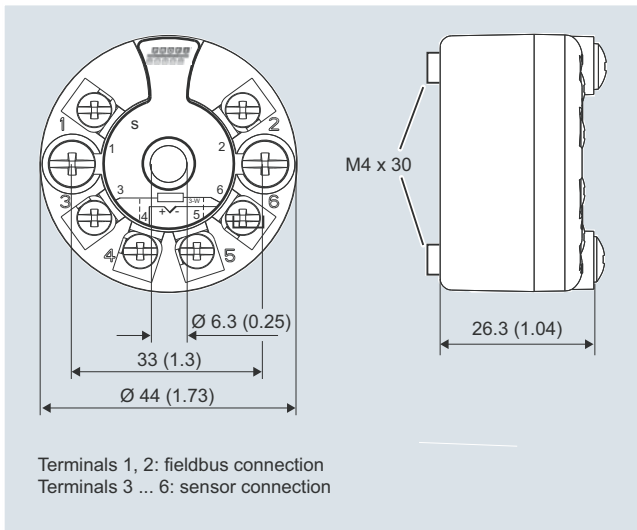


SITRANS TH400 dimensions in mm (inches) and connections

Mounting on DIN rail

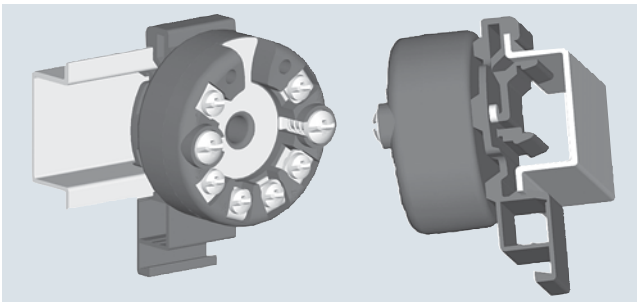


SITRANS TH400, mounting of transmitter on DIN rail

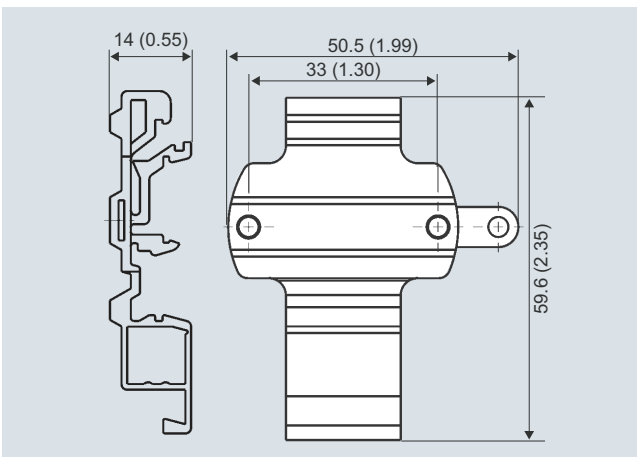

DIN rail adaptor, dimensions in mm (inch)

Schematics

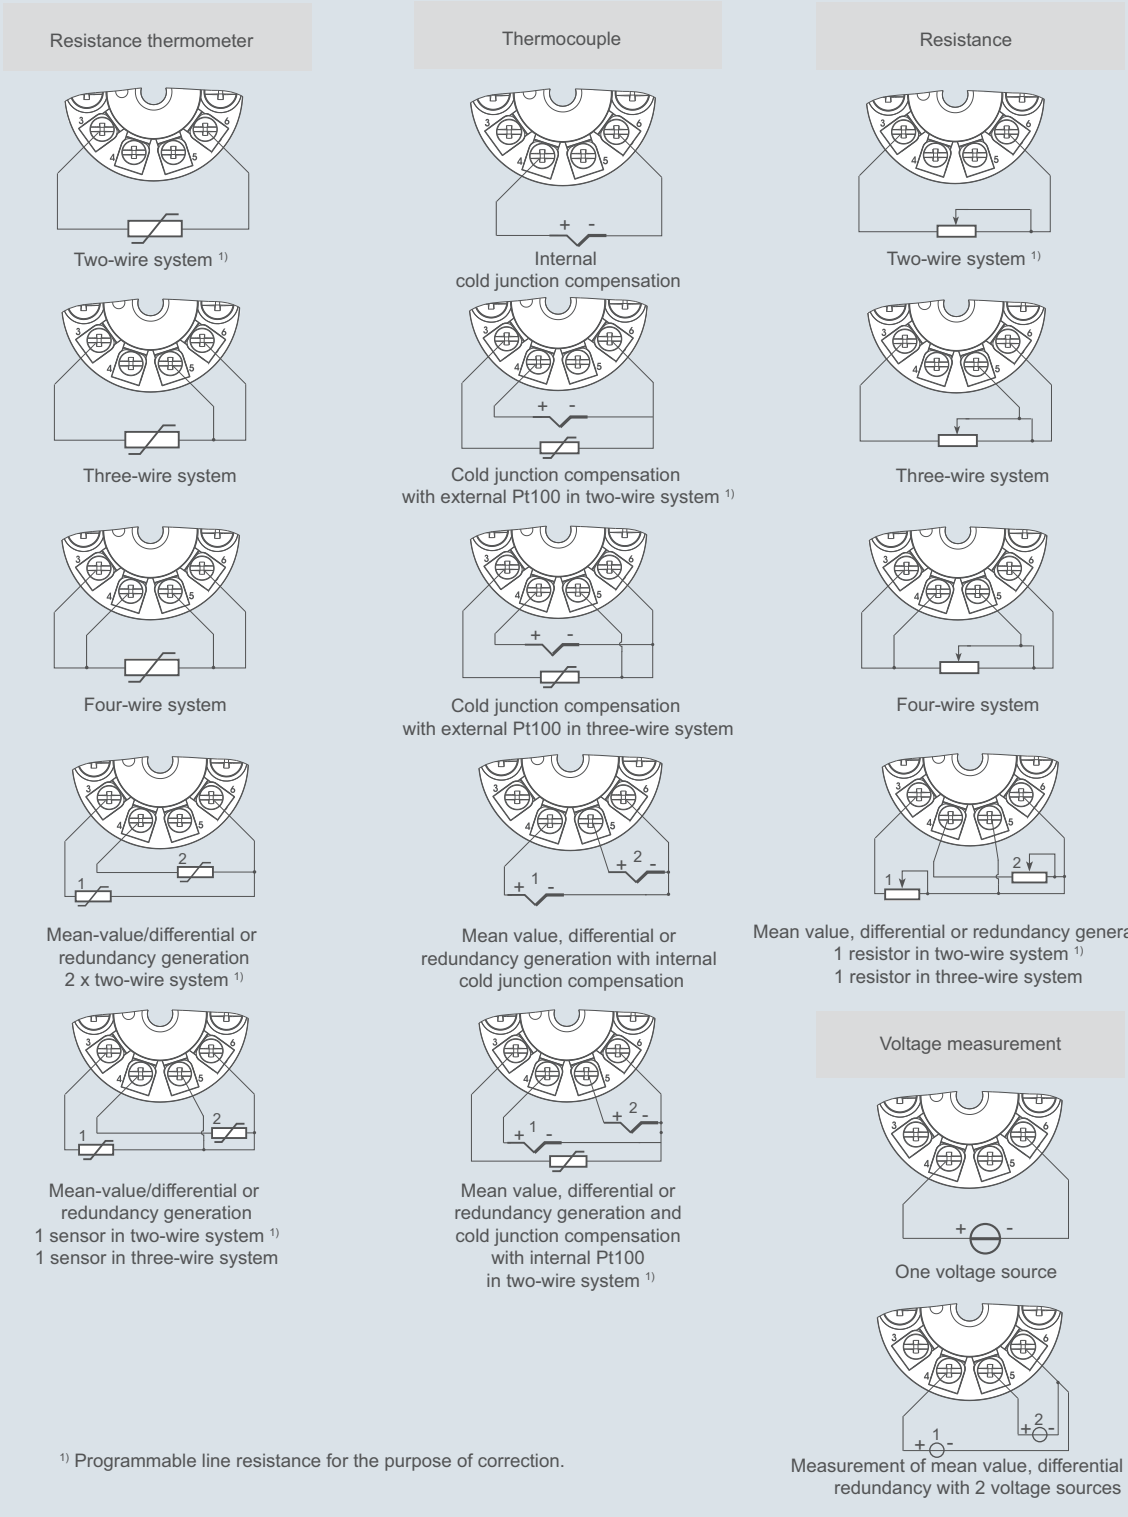

¹⁾ Programmable line resistance for the purpose of correction.